

Skyscraper Segmental Retaining Wall



Design Chart (Canada)

TECHO—BLOC

Table of contents

PREFACE.....3

PRODUCT OVERVIEW & TECHNICAL SPECIFICATIONS4

DESIGN CHARTS: NOTES AND ASSUMPTIONS.....6

TYPICAL CROSS SECTION DETAILS7

INCLINED POSITION

SAND & GRAVEL MIXES

Case N° 1: No surcharge, No backslope, No Toe Slope.....8

Case N° 2: 6 kPa Surcharge , No backslope, No Toe Slope.....9

Case N° 3: 12 kPa Surcharge, No backslope, No Toe Slope10

Case N° 4: No surcharge, 1V:3H backslope, No Toe Slope.....11

CLEAN SAND

Case N° 5: No surcharge, No backslope, No Toe Slope.....12

Case N° 6: 6 kPa Surcharge, No backslope, No Toe Slope13

Case N° 7: 12 kPa Surcharge, No backslope, No Toe Slope14

Case N° 8: No surcharge, 1V:3H backslope, No Toe Slope.....15

LOW PLASTICITY SILTS AND CLAYS

Case N° 9: No surcharge, No backslope, No Toe Slope.....16

Case N° 10: 100 psf Surcharge, No backslope, No Toe Slope17

Case N° 11: 250 psf Surcharge, No backslope, No Toe Slope18

Case N° 12: No surcharge, 1V:3H backslope, No Toe Slope19

CLEAR CRUSHED STONE BACKFILL OVER POOR SOIL CONDITIONS

Case N° 13: No surcharge, No backslope, No Toe Slope.....20

Case N° 14: 6 kPa Surcharge, No backslope, No Toe Slope21

Case N° 15: 12 kPa Surcharge, No backslope, No Toe Slope.....22

Case N° 16: No surcharge, 1V:3H backslope, No Toe Slope23

NEAR VERTICAL

SAND & GRAVEL MIXES

Case N° 1: No surcharge, No backslope, No Toe Slope.....24

Case N° 2: 6 kPa Surcharge , No backslope, No Toe Slope.....25

Case N° 3: 12 kPa Surcharge, No backslope, No Toe Slope26

Case N° 4: No surcharge, 1V:3H backslope, No Toe Slope.....27

CLEAN SAND

Case N° 5: No surcharge, No backslope, No Toe Slope.....28

Case N° 6: 6 kPa Surcharge, No backslope, No Toe Slope29

Case N° 7: 12 kPa Surcharge, No backslope, No Toe Slope30

Case N° 8: No surcharge, 1V:3H backslope, No Toe Slope.....31

LOW PLASTICITY SILTS AND CLAYS

Case N° 9: No surcharge, No backslope, No Toe Slope.....32

Case N° 10: 6 kPa Surcharge, No backslope, No Toe Slope33

Case N° 11: 12 kPa Surcharge, No backslope, No Toe Slope.....34

Case N° 12: No surcharge, 1V:3H backslope, No Toe Slope35

CLEAR CRUSHED STONE BACKFILL OVER POOR SOIL CONDITIONS

Case N° 13: No surcharge, No backslope, No Toe Slope.....36

Case N° 14: 6 kPa Surcharge, No backslope, No Toe Slope37

Case N° 15: 12 kPa Surcharge, No backslope, No Toe Slope.....38

Case N° 16: No surcharge, 1V:3H backslope, No Toe Slope39

Preface

This document contains the preliminary design charts for the SKYSCRAPER retaining wall system. The charts help to determine the optimized block configuration for several wall heights under specific assumed conditions.

First, evaluate the proposed conditions for the retaining wall project. It is important to determine the soil type, the applied surcharge and the backslope/toeslope conditions that most closely represent the final constructed wall. Second, select the desired wall inclination; inclined (12.7°) or near vertical (0.8°). Third, select the chart case number that most closely resembles the final project conditions. Finally, select the wall height that will best fit the project wall profile.

This document has been prepared for the following cases:


	SOIL	SURCHARGE	BACKSLOPE	TOESLOPE
CASE N° 1	Sand & gravel mixes	No	No	No
CASE N° 2	Sand & gravel mixes	6 kPa	No	No
CASE N° 3	Sand & gravel mixes	12 kPa	No	No
CASE N° 4	Sand & gravel mixes	No	1V: 3H	No
CASE N° 5	Clean Sand	No	No	No
CASE N° 6	Clean Sand	6 kPa	No	No
CASE N° 7	Clean Sand	12 kPa	No	No
CASE N° 8	Clean Sand	No	1V: 3H	No
CASE N° 9	Low Plasticity Silts and Clays	No	No	No
CASE N° 10	Low Plasticity Silts and Clays	6 kPa	No	No
CASE N° 11	Low Plasticity Silts and Clays	12 kPa	No	No
CASE N° 12	Low Plasticity Silts and Clays	No	1V: 3H	No
CASE N° 13	Clear Crushed Stone Backfill over Poor soil conditions	No	No	No
CASE N° 14	Clear Crushed Stone Backfill over Poor soil conditions	6 kPa	No	No
CASE N° 15	Clear Crushed Stone Backfill over Poor soil conditions	12 kPa	No	No
CASE N° 16	Clear Crushed Stone Backfill over Poor soil conditions	No	1V: 3H	No

The information contained in this document is supplied for preliminary design purposes only. A registered Professional Engineer must be consulted for the final design to be used for construction. Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers can not under any circumstances be held liable for the use of these design charts for actual construction or for the incorrect use of information contained in these design charts. Final determination of the suitability for the use of this document is the sole responsibility of the user.

Product Overview


TOP UNIT

Approx. weight:
234.7 kg (517 lbs)

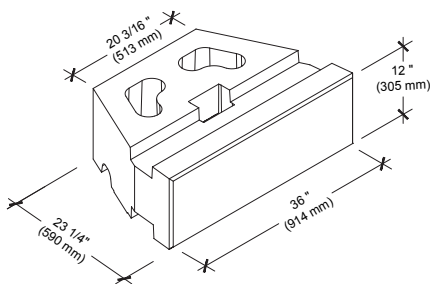


MIDDLE UNIT

Approx. weight:
335.2 kg (739 lbs)

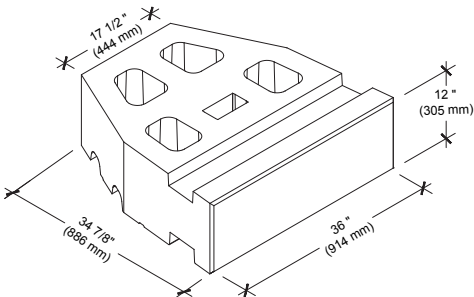


**PRECAST CONCRETE
"U" CONNECTOR**
(alignment pin)




BASE UNIT

Approx. weight:
416.6 kg (918 lbs)

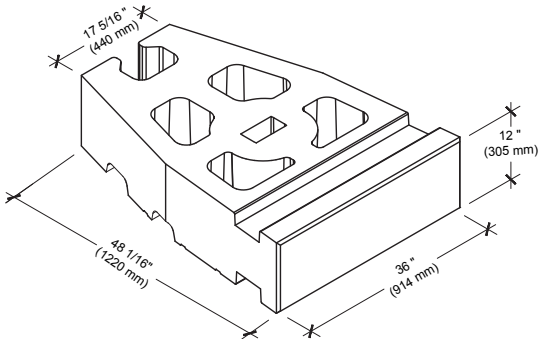


EXTENDER UNIT


Approx. weight:
206.7 kg (456 lbs)

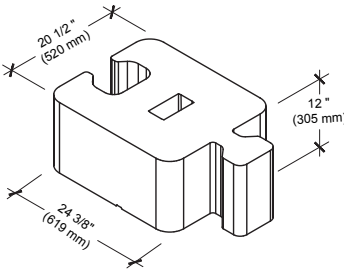

**PRECAST CONCRETE
"Z" CONNECTOR**



PATTERN
Linear Pattern

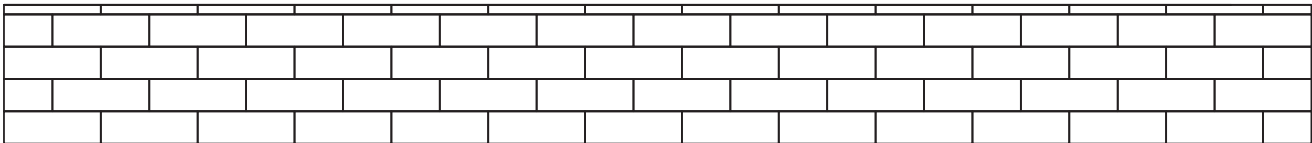

Technical Specifications

PHYSICAL CHARACTERISTICS

Compressive Strength	35 MPa (5050 psi)
Water Absorption (max.)	144 kg/m ³ (9 lb/ft ³)
Freeze-Thaw	1.0% max. loss of mass after 100 cycles; or 1.5% max. loss of mass after 150 cycles
Dimensional Tolerances	Height: ± 1.5 mm [$\frac{1}{16}$ in.] Length & Width: ± 3 mm [$\frac{1}{8}$ in.]

Note: Meets and exceeds the requirements of the ASTM C 1372 Standard Specification for Dry-Cast Segmental Retaining Wall Units.

DESIGN DATA

Horizontal Setback	68.5 mm (2 5⁄16 in.)	4.5 mm (3⁄16 in.)			
Infilled Unit Weight	TOP	18.0 kN/m³ (115 pcf)			
	MIDDLE	18.1 kN/m³ (115 pcf)			
	BASE	17.5 kN/m³ (111 pcf)			
	BASE +EXTENDER(S)	Variable			
Infilled center of gravity (measured from the face of the unit)	TOP	294 mm (11 9⁄16 in.)			
	MIDDLE	437 mm (17 3⁄16 in.)			
	BASE	586 mm (23 1⁄16 in.)			
	BASE +EXTENDER(S)	Variable			
Block Shear Strength (Inclined Position) (ASTM D 6916)	Vub[kN/m] =	N≤	73.7	1.95 + N*tan(43.5)	
		73.7 < N ≤	120.1	30.97 + N*tan(29.0)	
		N>	120.1	**	N*tan(31.0)
	Vub[lb/ft] =	N≤	5050	134 + N*tan(43.5)	
		5050 < N ≤	8229	2124 + N*tan(29.0)	
		N>	8229	**	N*tan(31.0)
Block Shear Strength (Near Vertical Position) (ASTM D 6916)	Vub[kN/m] =	N≤	124.8	24.62 + N*tan(35.7)	
		N>	124.8	**	N*tan(31.0)
	Vub[lb/ft] =	N≤	8559	1689 + N*tan(35.7)	
		N>	8559	**	N*tan(31.0)

Notes:

1. The infilled unit weight shown here is based on an assumed aggregate unit weight of 1550 kg/m³ (96.8 lb/ft³) used to fill the core cavity of the block and the space between adjacent blocks.

**Block shear strength obtained from weighted average friction coefficient analysis (concrete to concrete friction: 0.6, concrete to aggregate: $0.8 \cdot \tan(\phi \text{ aggregate})$, aggregate to aggregate: $\tan(\phi \text{ aggregate})$).

Design Charts

Notes and Assumptions

This preliminary guide has been prepared for different soil types to approximate good (sand & gravel mixes), medium (Clean Sand) and poor (Low Plasticity Silts and Clays) soil conditions to cover the typical design range. Moreover, a soil condition was prepared to consider the replacement of a poor soil by a free drainage backfill behind the wall (Clear crushed stone backfill over poor soil conditions). The description of the soil is provided for information purposes; it is the actual shear strength parameter that will govern the design.

Additionally, the following four different load conditions were considered:

- I. A horizontal surface above the wall with no surcharge to account for lawn or similar load conditions.
- II. A horizontal surface above the wall with a uniform surcharge of 6 kPa (125 psf) to account for paved surfaces and/or parking or alleys for car and light vehicles traffic.
- III. A horizontal surface above the wall with a uniform surcharge of 12 kPa (250 psf) to account for heavy vehicle traffic or fire lanes.
- IV. A 1V:3H slope above the wall (backslope).

Furthermore, each case contains two setback alternatives: one for a wall with 12.7° batter and one for a near vertical wall (0.8°). The 12.7° wall inclination is achieved by using the precast concrete “Z” connector and the 0.8° wall inclination (Near vertical) by using the precast concrete “U” connector.

No slope condition below the wall (Toeslope) was considered. The design parameters and additional assumptions are shown in each chart. Skyscraper walls are not limited to the conditions contained in these charts. Wall section for different soil, slope, loading and height conditions can be designed.

The design charts show the optimized block combination for a Skyscraper wall, based on the height of the wall, the soil type and the load conditions. The wall height varies approximately from 0.61 m (2.0 ft) to 7.01 m (23.0 ft), gradually increasing in height increments of 0.30-0.61 m (1.0-2.0 ft). The wall height shown does not include the thickness of the cap.



The gravity walls charts have been prepared from an allowable stress design (ASD) procedure based in the industry practice and the Design Manual for Segmental Retaining Walls from the National Concrete Masonry Association (NCMA), 3rd edition. Additional analytical methods and theories for a Multiple Depth Precast Modular Block Gravity Retaining Wall are taken from AASHTO and FHWA guidelines. Minimum factors of safety were taken as: 1.5 for sliding; 1.5 for overturning and 2.0 for bearing capacity. Other factors of safety, analyzes and considerations such as global stability, seismic analysis and hydrostatic pressure, may result in a different wall design configuration.

Guard and barriers at the top of the wall must be designed and detailed by a registered Professional Engineer to assure the performance for specific site conditions. Railing, fence, guardrail and traffic barrier design may result in changes to available wall heights and block combinations shown in this document.

The design charts contained herein have been compiled and prepared by Techo-Bloc and to the best of its knowledge. Final determination of the suitability for the use of this document is the sole responsibility of the user. Final design for construction purposes shall be performed, using the actual conditions of the proposed site, by a registered Professional Engineer. For further information, please contact our technical service department.

Gravity Wall

Typical cross section detail

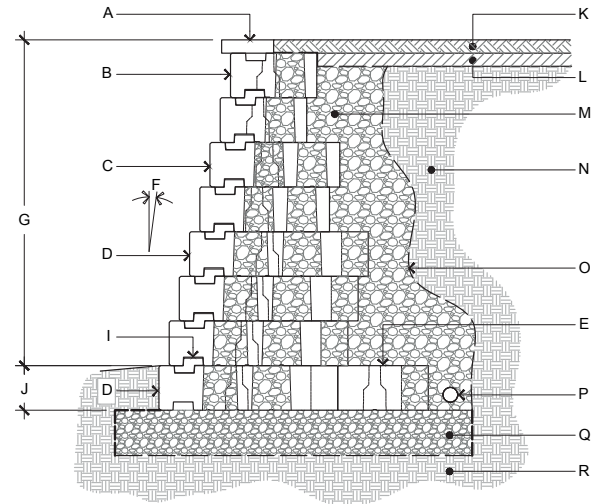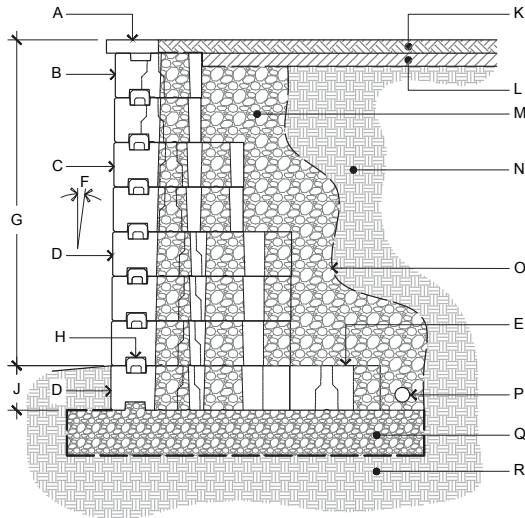

Gravity Near Vertical Wall Detail

- A. CAP FROM TECHO-BLOC
- B. SKYSCRAPER TOP UNIT FROM TECHO-BLOC
- C. SKYSCRAPER MIDDLE UNIT FROM TECHO-BLOC
- D. SKYSCRAPER BASE UNIT FROM TECHO-BLOC
- E. SKYSCRAPER EXTENDER UNIT FROM TECHO-BLOC
- F. WALL INCLINATION: 0.8"
- G. EXPOSED HEIGHT
- H. PRECAST CONCRETE "U" CONNECTOR
- J. EMBEDMENT DEPTH
- K. TOP SOIL
- L. LOW PERMEABILITY SOIL
- M. 3/4" (20 mm) CLEAN STONE, 12" (300 mm) THICK MIN
- N. RETAINED SOIL
- O. GEOTEXTILE
- P. PERFORATED DRAIN
- Q. LEVELING PAD
- R. FOUNDATION SOIL

Gravity Near Inclined Wall Detail


- A. CAP FROM TECHO-BLOC
- B. SKYSCRAPER TOP UNIT FROM TECHO-BLOC
- C. SKYSCRAPER MIDDLE UNIT FROM TECHO-BLOC
- D. SKYSCRAPER BASE UNIT FROM TECHO-BLOC
- E. SKYSCRAPER EXTENDER UNIT FROM TECHO-BLOC
- F. Wall inclination: 12.7"
- G. EXPOSED HEIGHT
- H. PRECAST CONCRETE "Z" CONNECTOR
- J. EMBEDMENT DEPTH
- K. TOP SOIL
- L. LOW PERMEABILITY SOIL
- M. 3/4" (20 mm) CLEAN STONE, 12" (300 mm) THICK MIN
- N. RETAINED SOIL
- O. GEOTEXTILE
- P. PERFORATED DRAIN
- Q. LEVELING PAD
- R. FOUNDATION SOIL

ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 1 :
No Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5




1.83 m (6 ft) Total Height
T: 6




2.13 m (7 ft) Total Height
T: 7




2.44 m (8 ft) Total Height
T: 4
M: 4

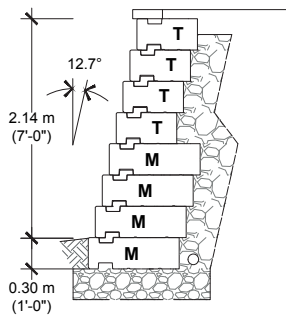

2.74 m (9 ft) Total Height
T: 1
M: 8

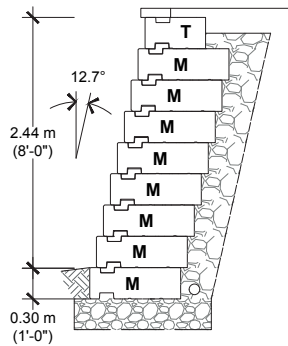


3.05 m (10 ft) Total Height
M: 10

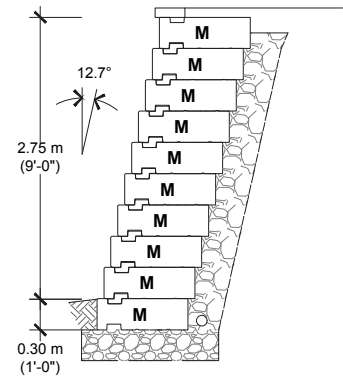


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 2 :
6 kPa Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

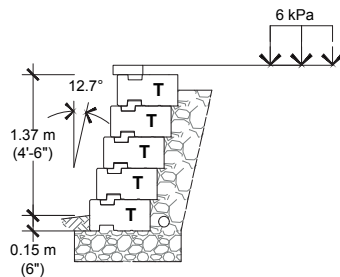


1.83 m (6 ft) Total Height
T: 6

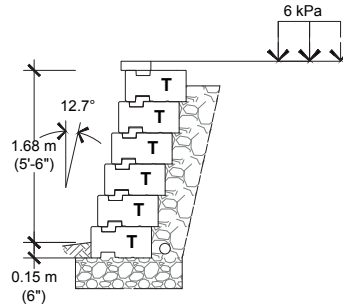


2.13 m (7 ft) Total Height
T: 3
M: 4

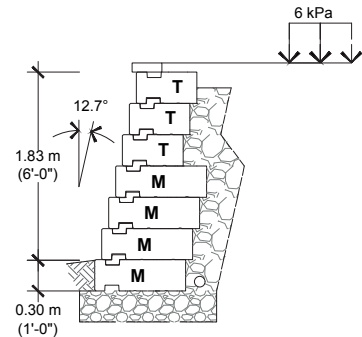


2.44 m (8 ft) Total Height
M: 8

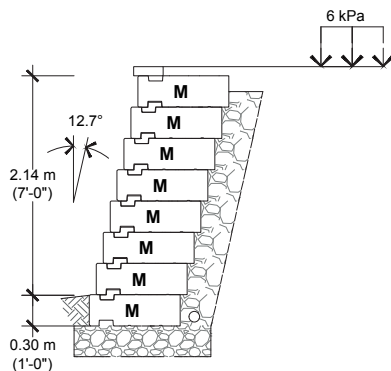

2.74 m (9 ft) Total Height
M: 9

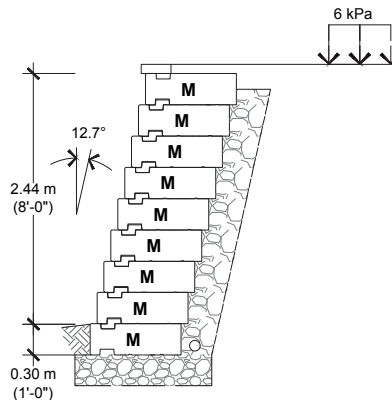


3.05 m (10 ft) Total Height
M: 9
B: 1

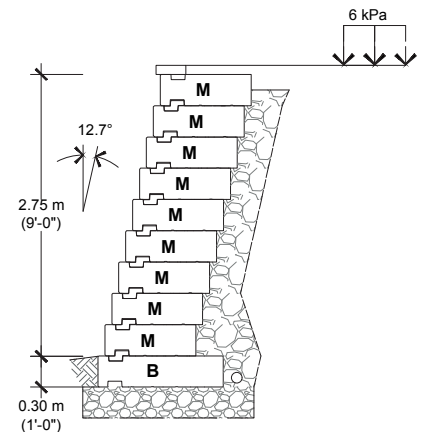

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

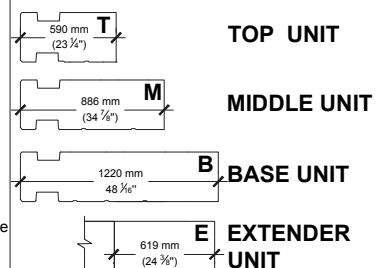


ALLOWABLE STRESS DESIGN

SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)


CASE N° 3 :

12 kPa Surcharge
No Backslope
No Toe Slope


1.22 m (4 ft) Total Height
T: 4

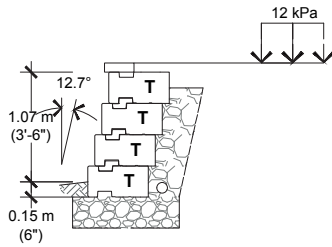


1.52 m (5 ft) Total Height
T: 1
M: 4

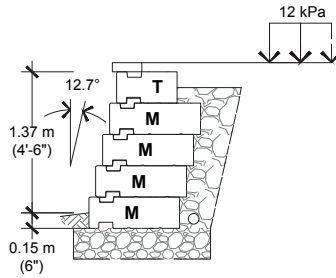


1.83 m (6 ft) Total Height
M: 6

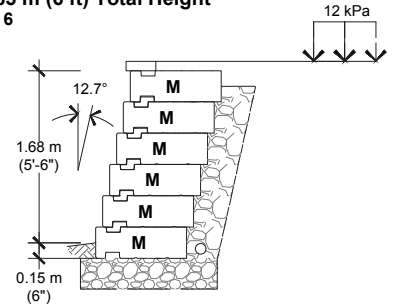


2.13 m (7 ft) Total Height
M: 7

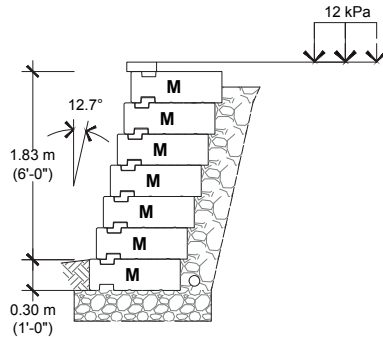


2.44 m (8 ft) Total Height
M: 5
B: 3

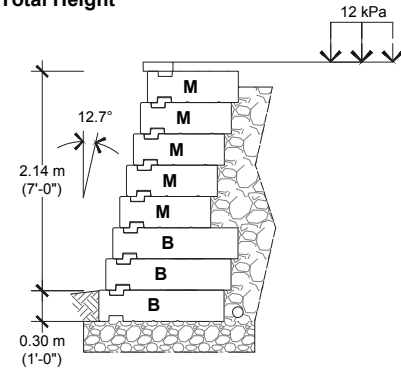

2.74 m (9 ft) Total Height
M: 1
B: 8

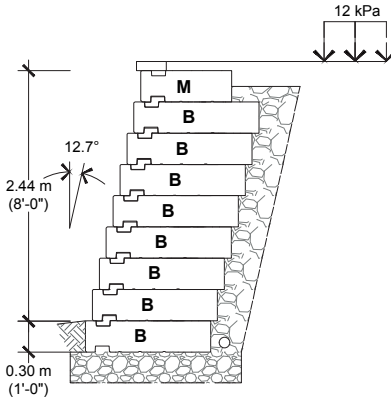


3.05 m (10 ft) Total Height
B: 10

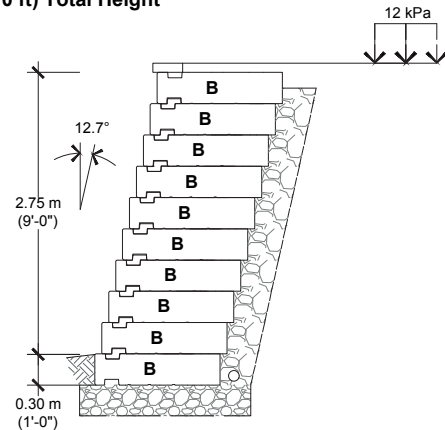


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT

TECHO—BLOC

DESIGN CHART SKYSCRAPER INCLINED POSITION


ALLOWABLE STRESS DESIGN

SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)


CASE N° 4 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

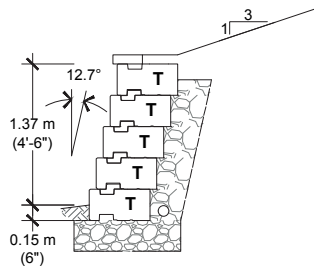


1.83 m (6 ft) Total Height
T: 6

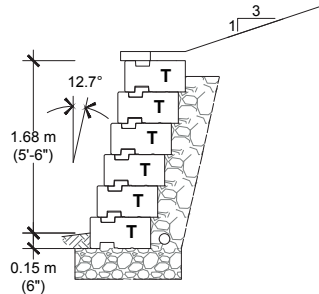


2.13 m (7 ft) Total Height
T: 3
M: 4

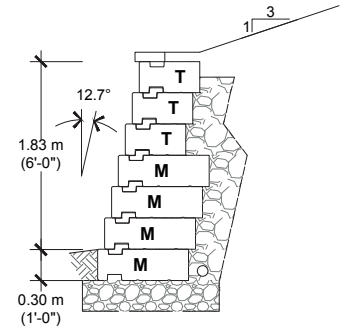


2.44 m (8 ft) Total Height
M: 8

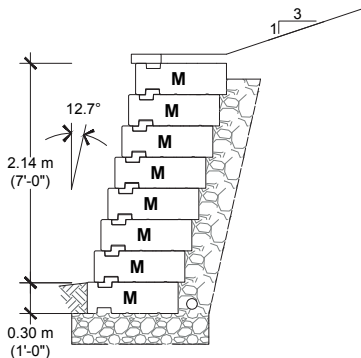

2.74 m (9 ft) Total Height
M: 9

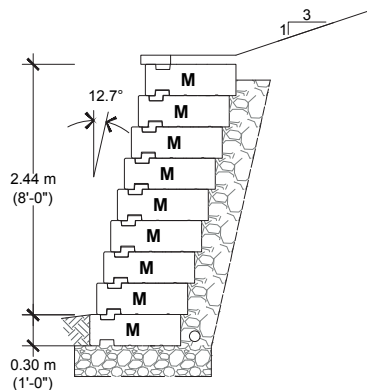


3.05 m (10 ft) Total Height
M: 3
B: 7

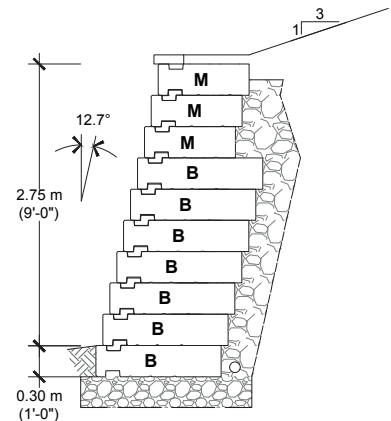


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 5 :
No Surcharge
No Backslope
No Toe Slope


1.83 m (6 ft) Total Height
T: 6




2.13 m (7 ft) Total Height
T: 6
M: 1




2.44 m (8 ft) Total Height
T: 2
M: 6

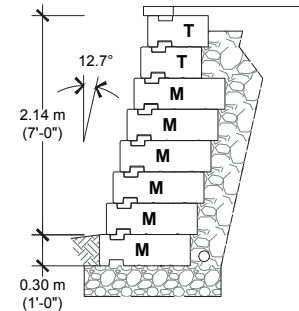

2.74 m (9 ft) Total Height
M: 9

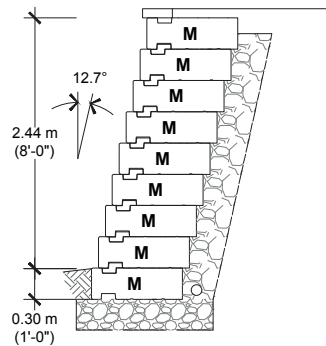


3.05 m (10 ft) Total Height
M: 9
B: 1

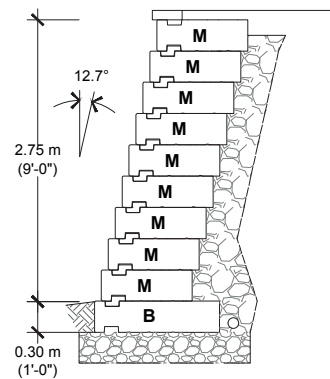


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 6 :
6 kPa Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

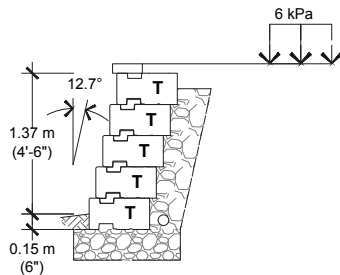


1.83 m (6 ft) Total Height
T: 3
M: 3

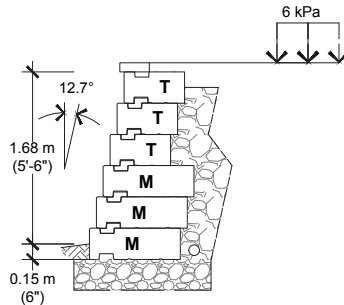


2.13 m (7 ft) Total Height
M: 7

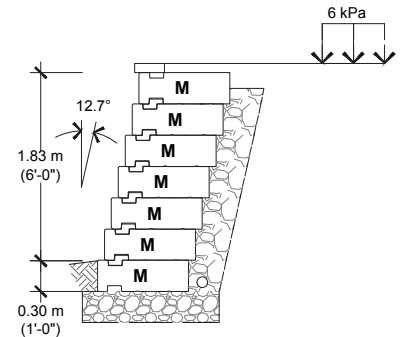


2.44 m (8 ft) Total Height
M: 8

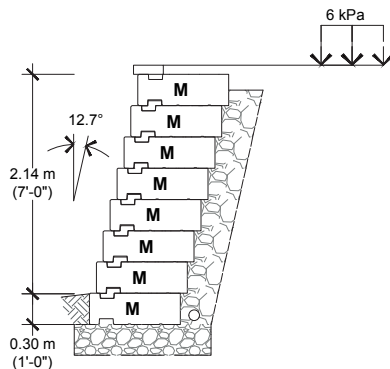

2.74 m (9 ft) Total Height
M: 8
B: 1

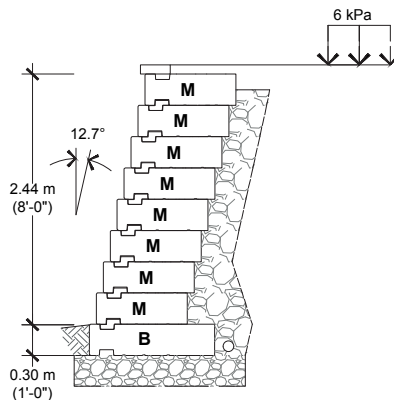


3.05 m (10 ft) Total Height
M: 1
B: 9

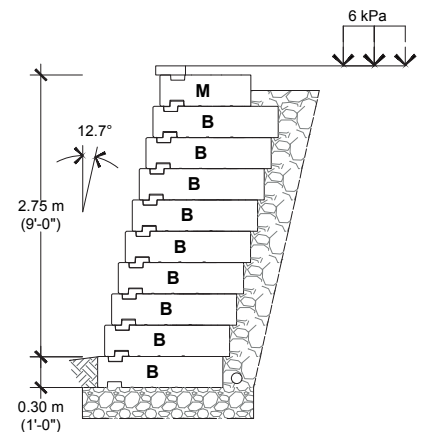


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 7 :
12 kPa Surcharge
No Backslope
No Toe Slope


0.91 m (3 ft) Total Height
T: 3

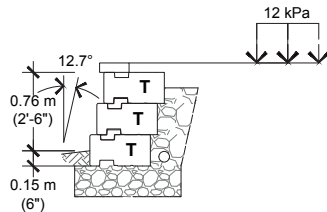


1.22 m (4 ft) Total Height
T: 1
M: 3

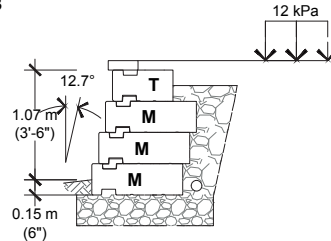


1.52 m (5 ft) Total Height
M: 5

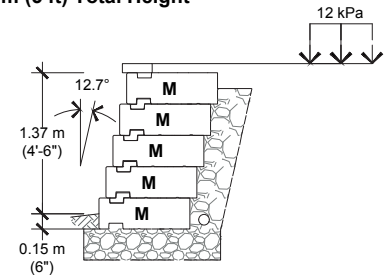


1.83 m (6 ft) Total Height
M: 6

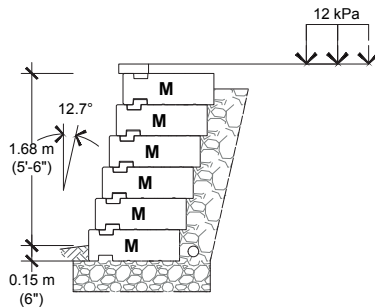


2.13 m (7 ft) Total Height
M: 3
B: 4

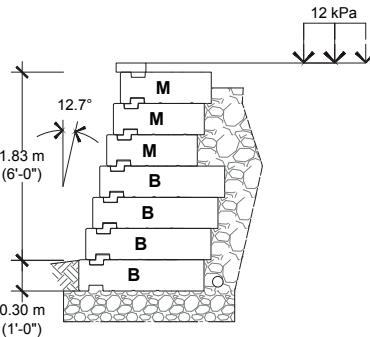


2.44 m (8 ft) Total Height
B: 8

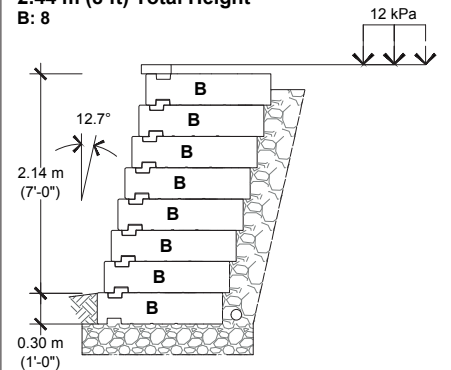

2.74 m (9 ft) Total Height
B: 9

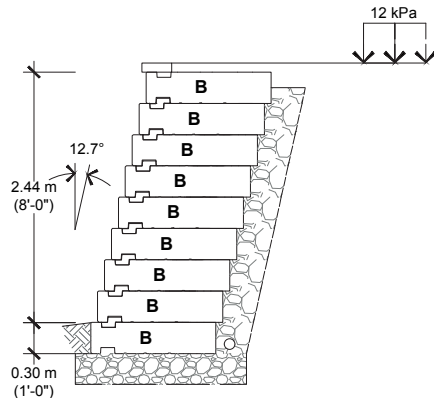


3.05 m (10 ft) Total Height
B: 9
BE: 1

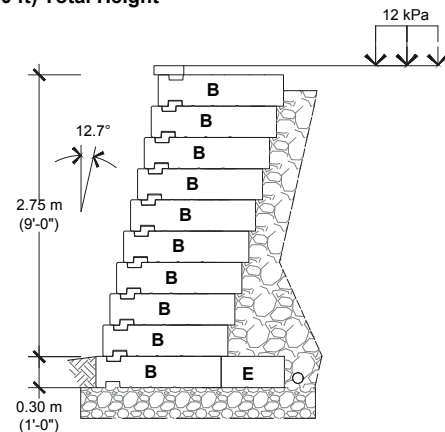

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

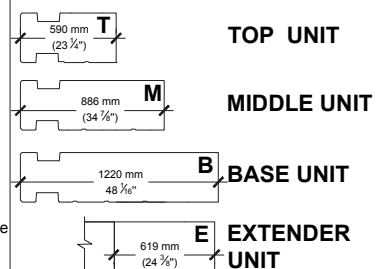


ALLOWABLE STRESS DESIGN

CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 8 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


1.22 m (4 ft) Total Height
T: 4

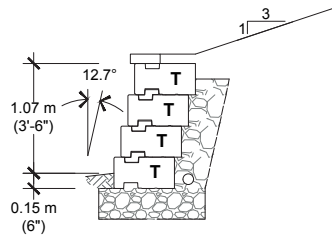


1.52 m (5 ft) Total Height
T: 5

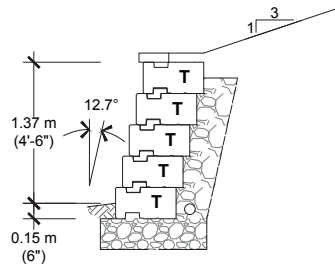


1.83 m (6 ft) Total Height
T: 5
M: 1

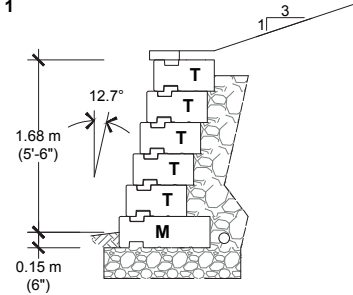


2.13 m (7 ft) Total Height
M: 7

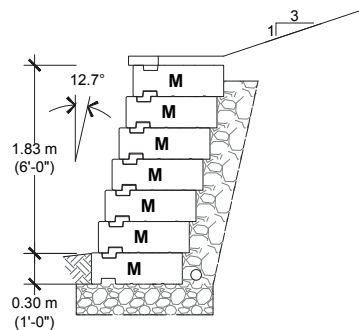


2.44 m (8 ft) Total Height
M: 7
B: 1

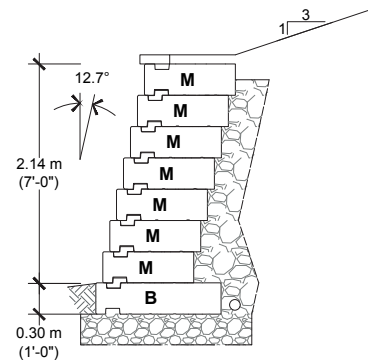

2.74 m (9 ft) Total Height
M: 3
B: 6

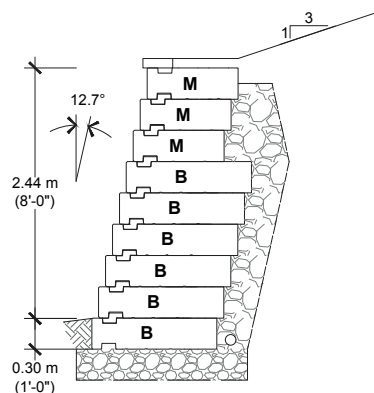


3.05 m (10 ft) Total Height
B: 9
BE: 1

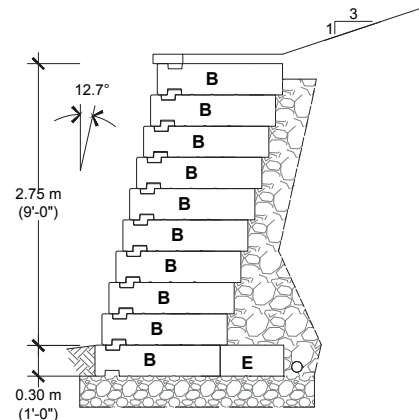


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT


ALLOWABLE STRESS DESIGN

LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 9 :

No Surcharge
No Backslope
No Toe Slope


1.22 m (4 ft) Total Height
T: 4




1.52 m (5 ft) Total Height
T: 4
M: 1




1.83 m (6 ft) Total Height
M: 6

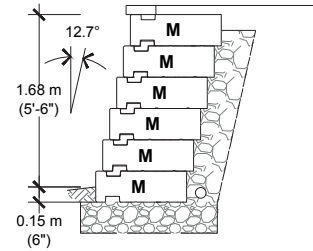


2.13 m (7 ft) Total Height
M: 6
B: 1

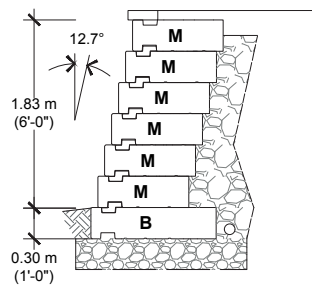


2.44 m (8 ft) Total Height
M: 1
B: 7

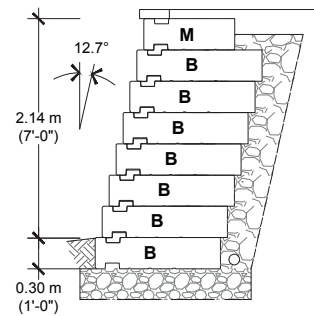

2.74 m (9 ft) Total Height
B: 9

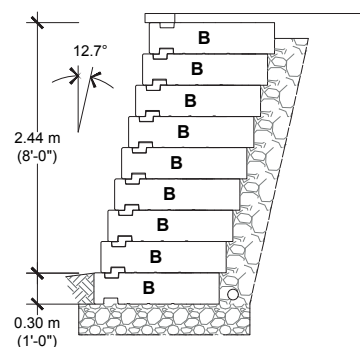


3.05 m (10 ft) Total Height
B: 9
BE: 1

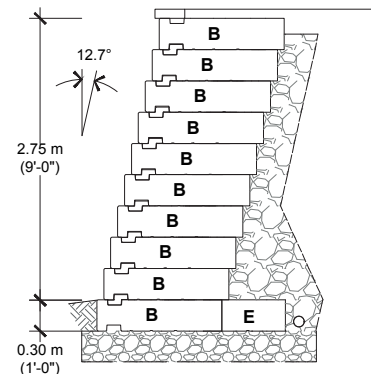


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 10 :
6 kPa Surcharge
No Backslope
No Toe Slope


0.91 m (3 ft) Total Height
T: 3

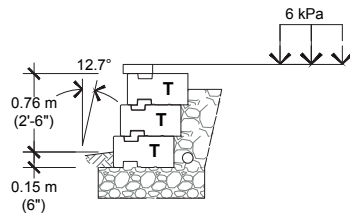


1.22 m (4 ft) Total Height
T: 1
M: 3

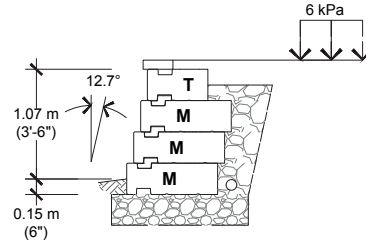


1.52 m (5 ft) Total Height
T: 5

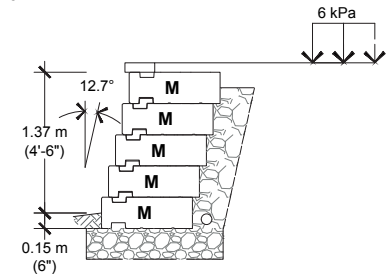


1.83 m (6 ft) Total Height
M: 5
B: 1

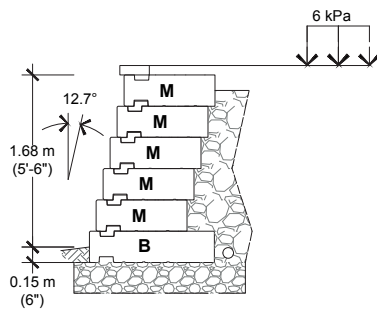


2.13 m (7 ft) Total Height
B: 7

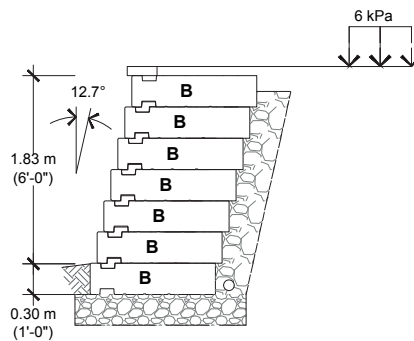


2.44 m (8 ft) Total Height
B: 8

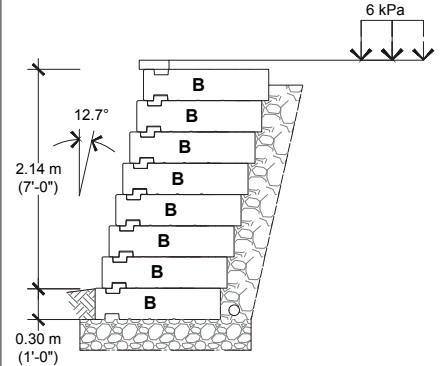

2.74 m (9 ft) Total Height
B: 7
BE: 2

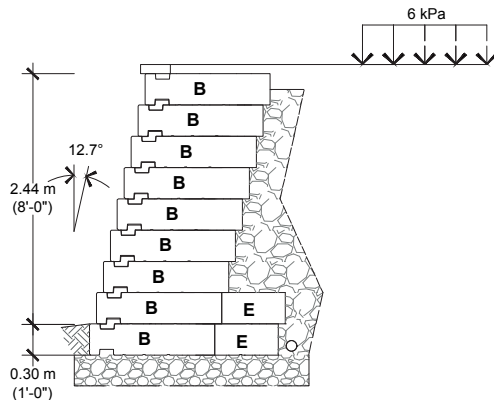


3.05 m (10 ft) Total Height
B: 3
BE: 7

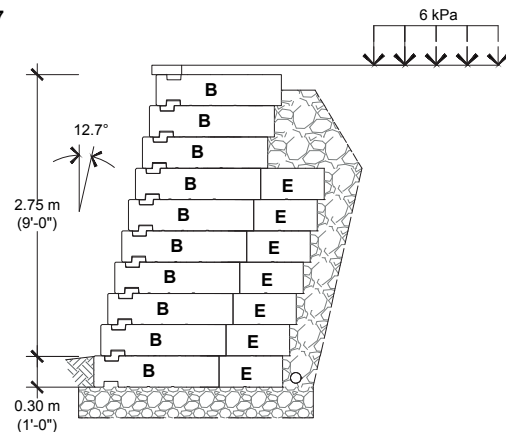


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 11 :
12 kPa Surcharge
No Backslope
No Toe Slope

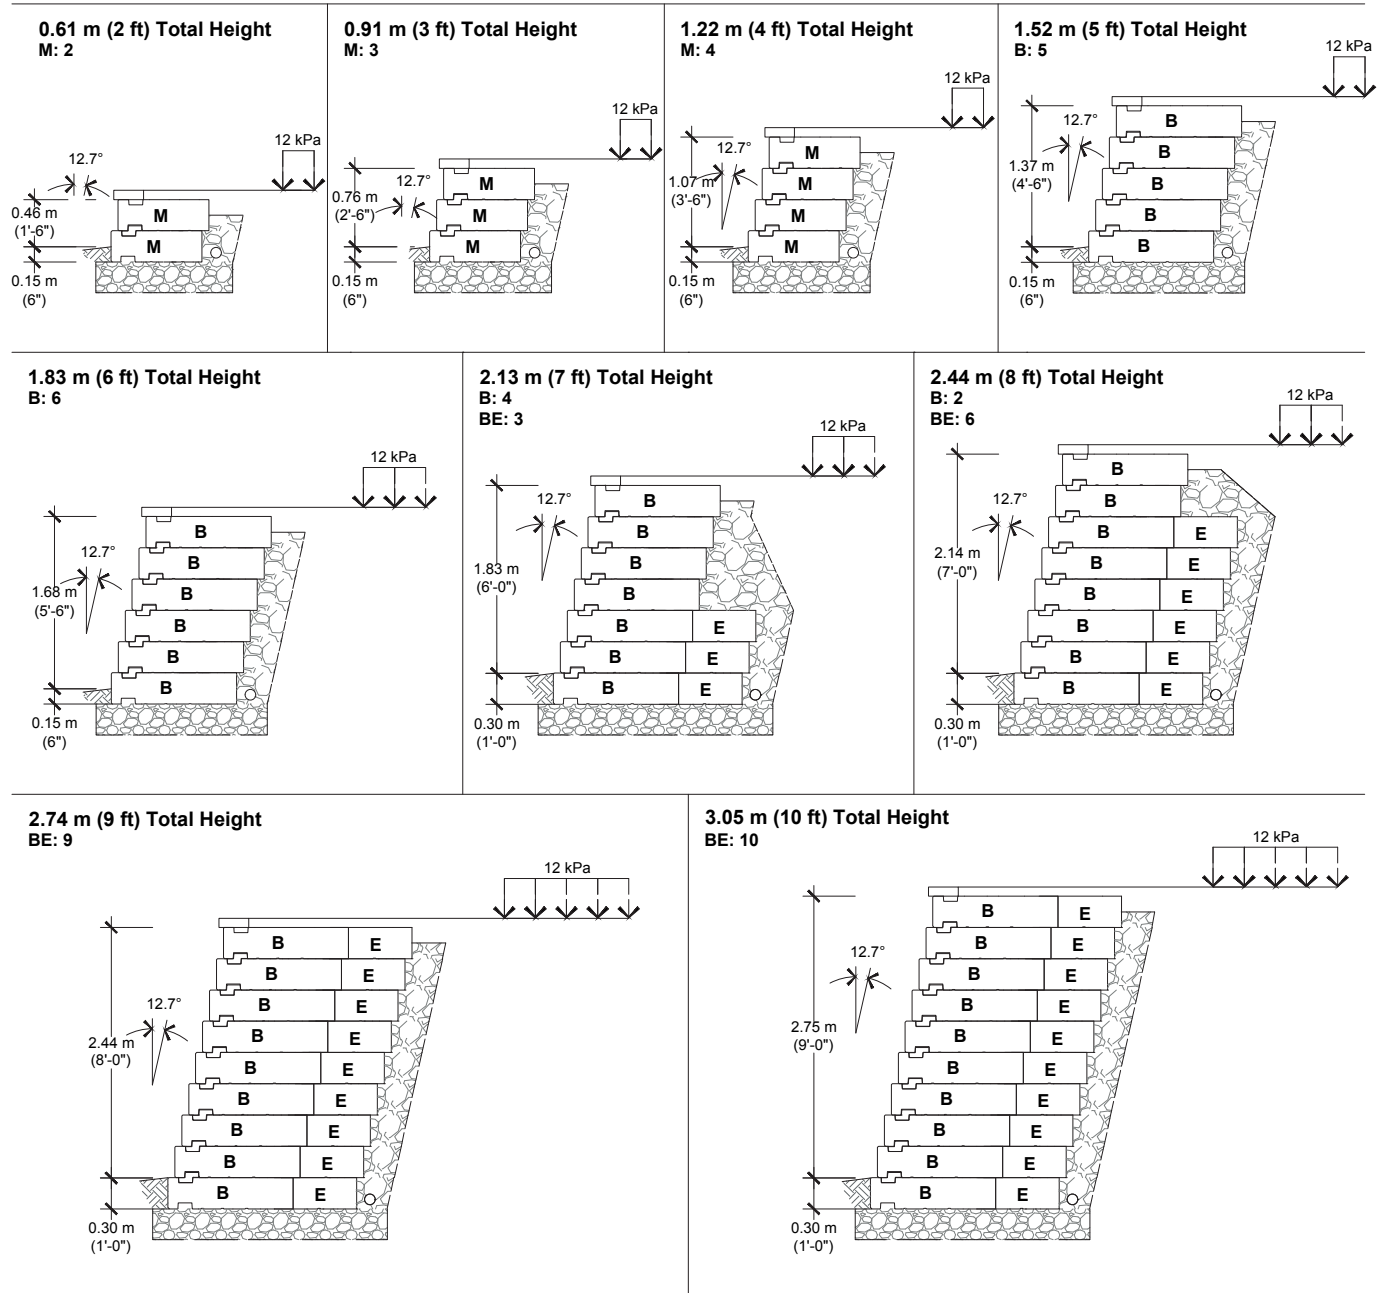

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$).
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

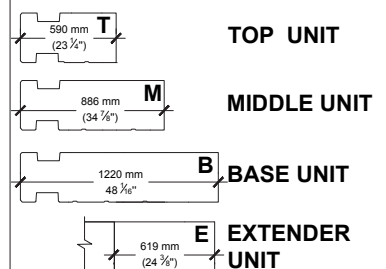

TECHO—BLOC

DESIGN CHART SKYSCRAPER INCLINED POSITION


ALLOWABLE STRESS DESIGN

LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 12 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


0.91 m (3 ft) Total Height
T: 3

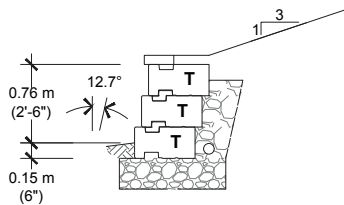


1.22 m (4 ft) Total Height
T: 3
M: 1

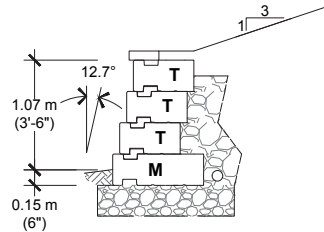


1.52 m (5 ft) Total Height
M: 5

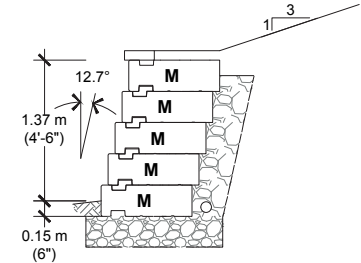


1.83 m (6 ft) Total Height
M: 2
B: 4

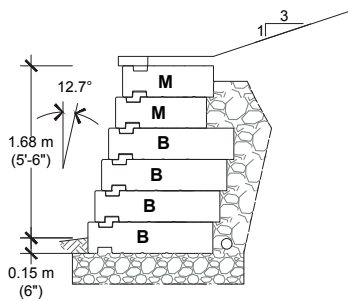


2.13 m (7 ft) Total Height
B: 6
BE: 1

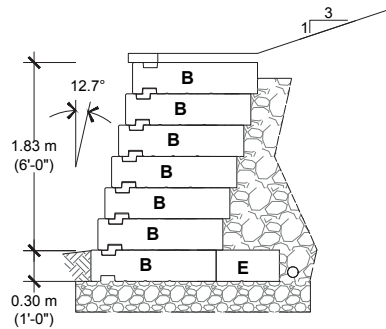


2.44 m (8 ft) Total Height
B: 5
BE: 3

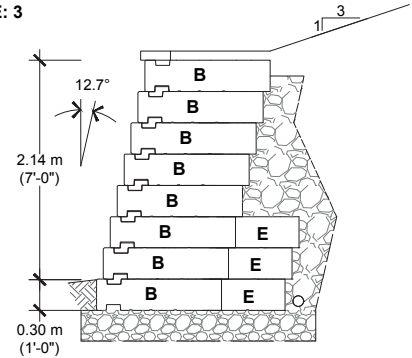

2.74 m (9 ft) Total Height
B: 1
BE: 8

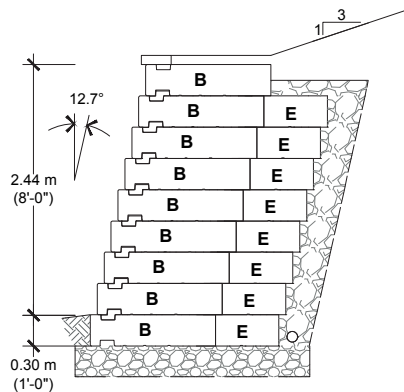


3.05 m (10 ft) Total Height
BE: 10

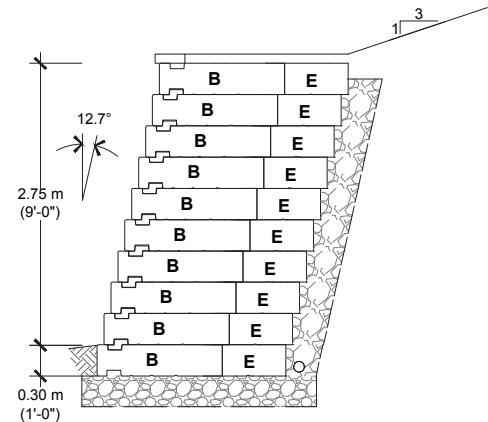


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT


ALLOWABLE STRESS DESIGN

CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 13 :

No Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

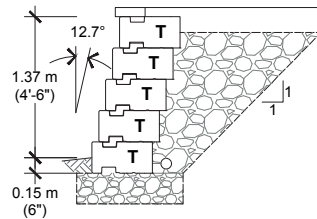


1.83 m (6 ft) Total Height
T: 6

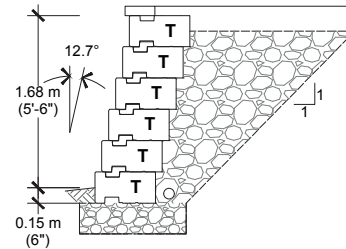


2.13 m (7 ft) Total Height
T: 7

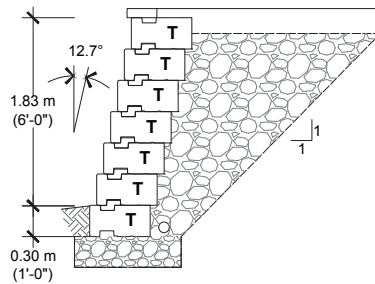


2.44 m (8 ft) Total Height
T: 8

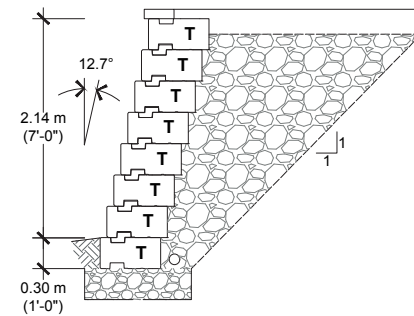

2.74 m (9 ft) Total Height
T: 9

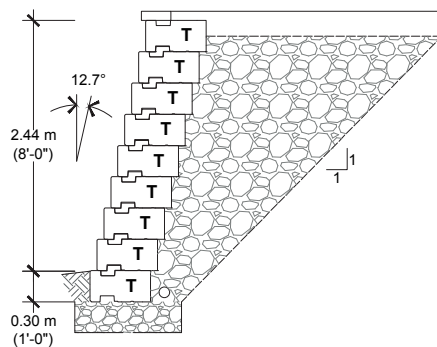


3.05 m (10 ft) Total Height
T: 9
M: 1

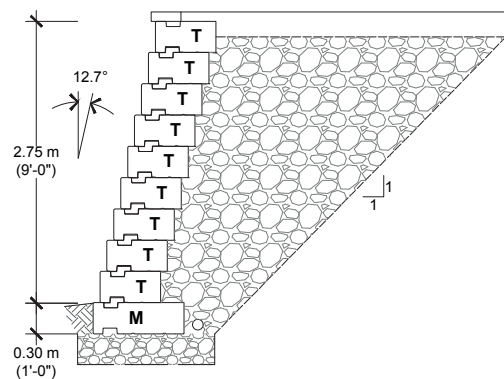


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 14 :
6 kPa Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

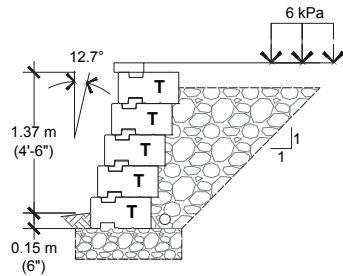


1.83 m (6 ft) Total Height
T: 6

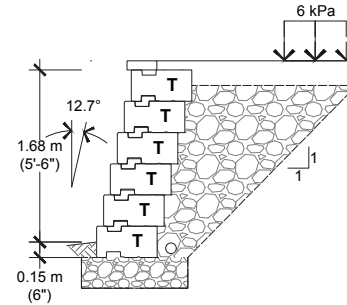


2.13 m (7 ft) Total Height
T: 7

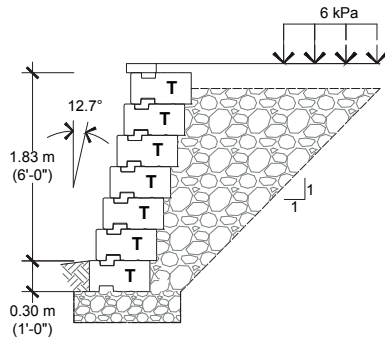


2.44 m (8 ft) Total Height
T: 8

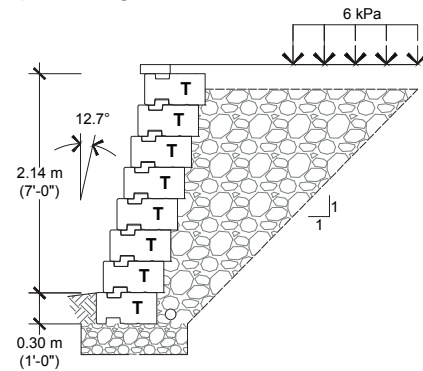

2.74 m (9 ft) Total Height
T: 8
M: 1

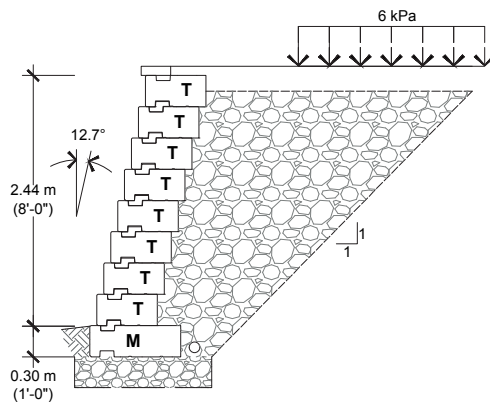


3.05 m (10 ft) Total Height
T: 5
M: 5

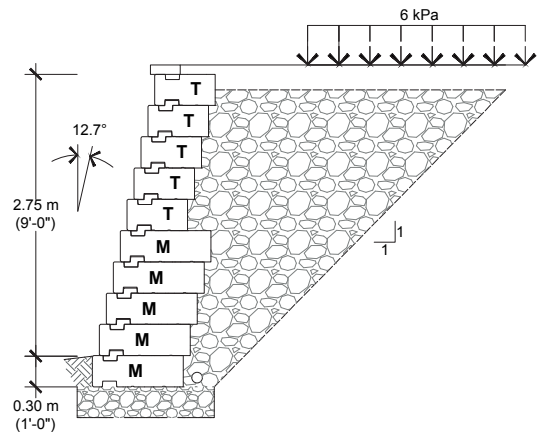


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT


ALLOWABLE STRESS DESIGN

CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 15 :

12 kPa Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

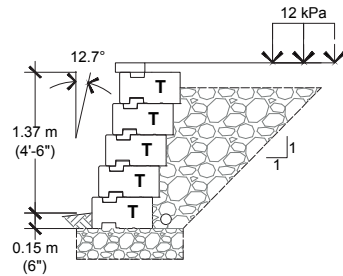


1.83 m (6 ft) Total Height
T: 6

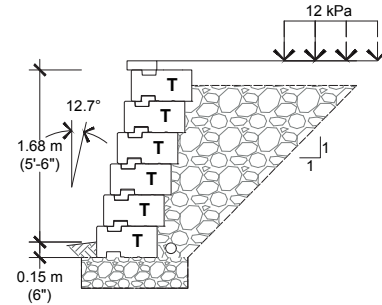


2.13 m (7 ft) Total Height
T: 5
M: 2

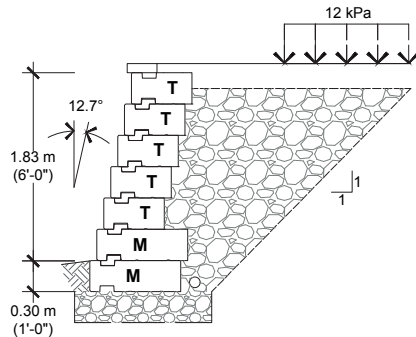


2.44 m (8 ft) Total Height
T: 2
M: 6

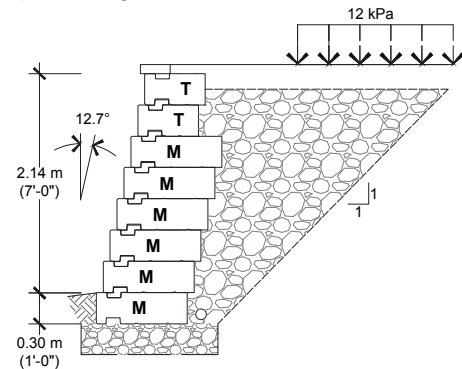

2.74 m (9 ft) Total Height
M: 9

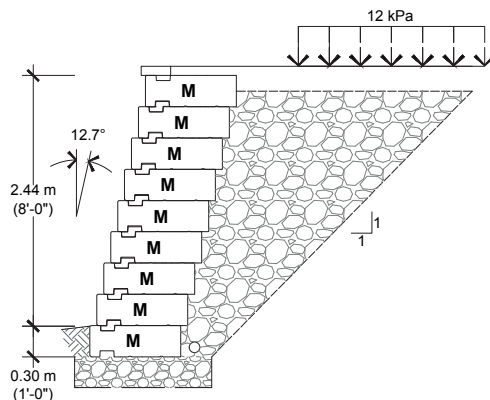


3.05 m (10 ft) Total Height
M: 10

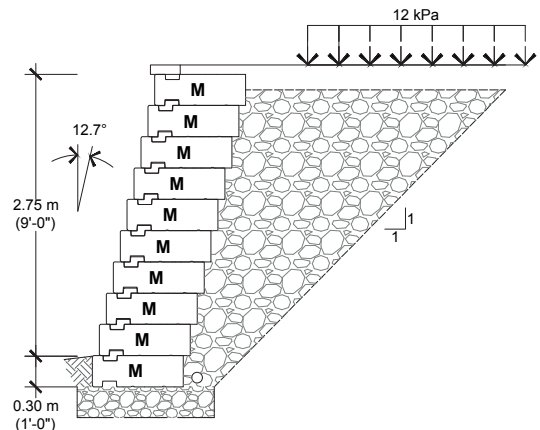


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT


ALLOWABLE STRESS DESIGN

CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 16 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

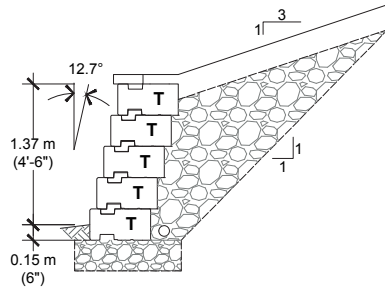


1.83 m (6 ft) Total Height
T: 6

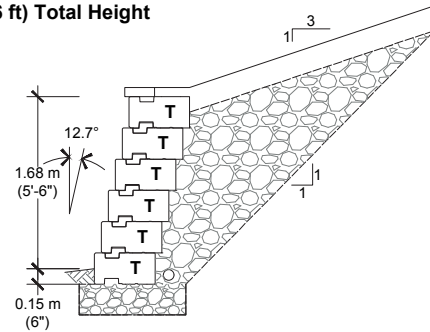


2.13 m (7 ft) Total Height
T: 7

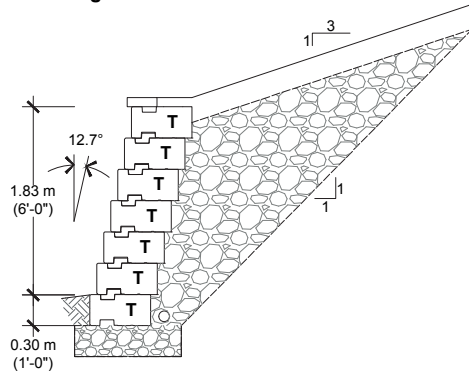


2.44 m (8 ft) Total Height
T: 8

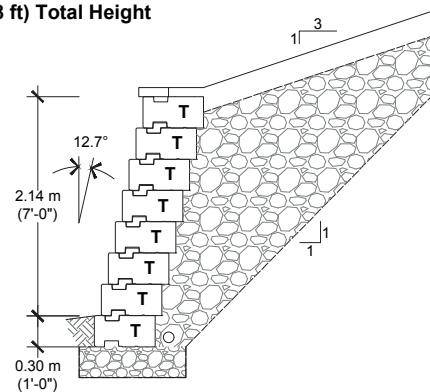

2.74 m (9 ft) Total Height
T: 8
M: 1

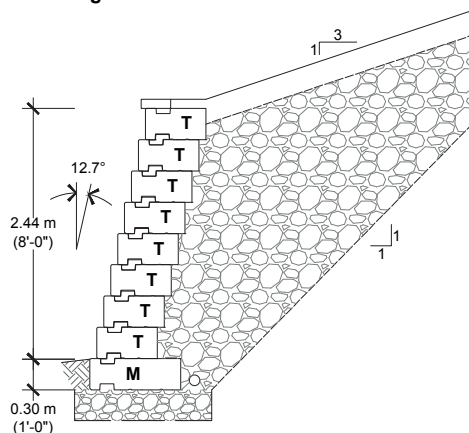


3.05 m (10 ft) Total Height
T: 5
M: 5

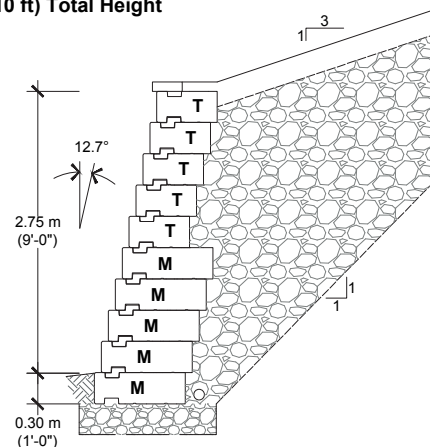


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 1 :
No Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5




1.83 m (6 ft) Total Height
T: 5
M: 1




2.13 m (7 ft) Total Height
T: 4
M: 3




2.44 m (8 ft) Total Height
M: 8

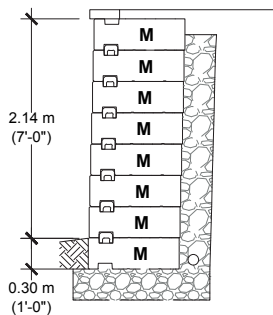

2.74 m (9 ft) Total Height
M: 8
B: 1

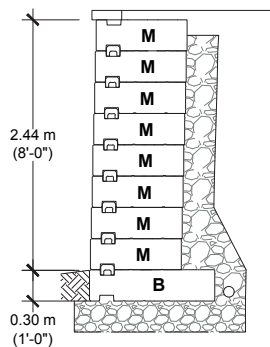


3.05 m (10 ft) Total Height
M: 5
B: 5

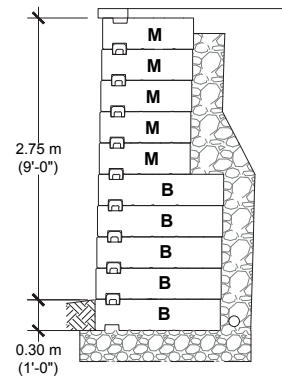


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 2 :
6 kPa Surcharge
No Backslope
No Toe Slope

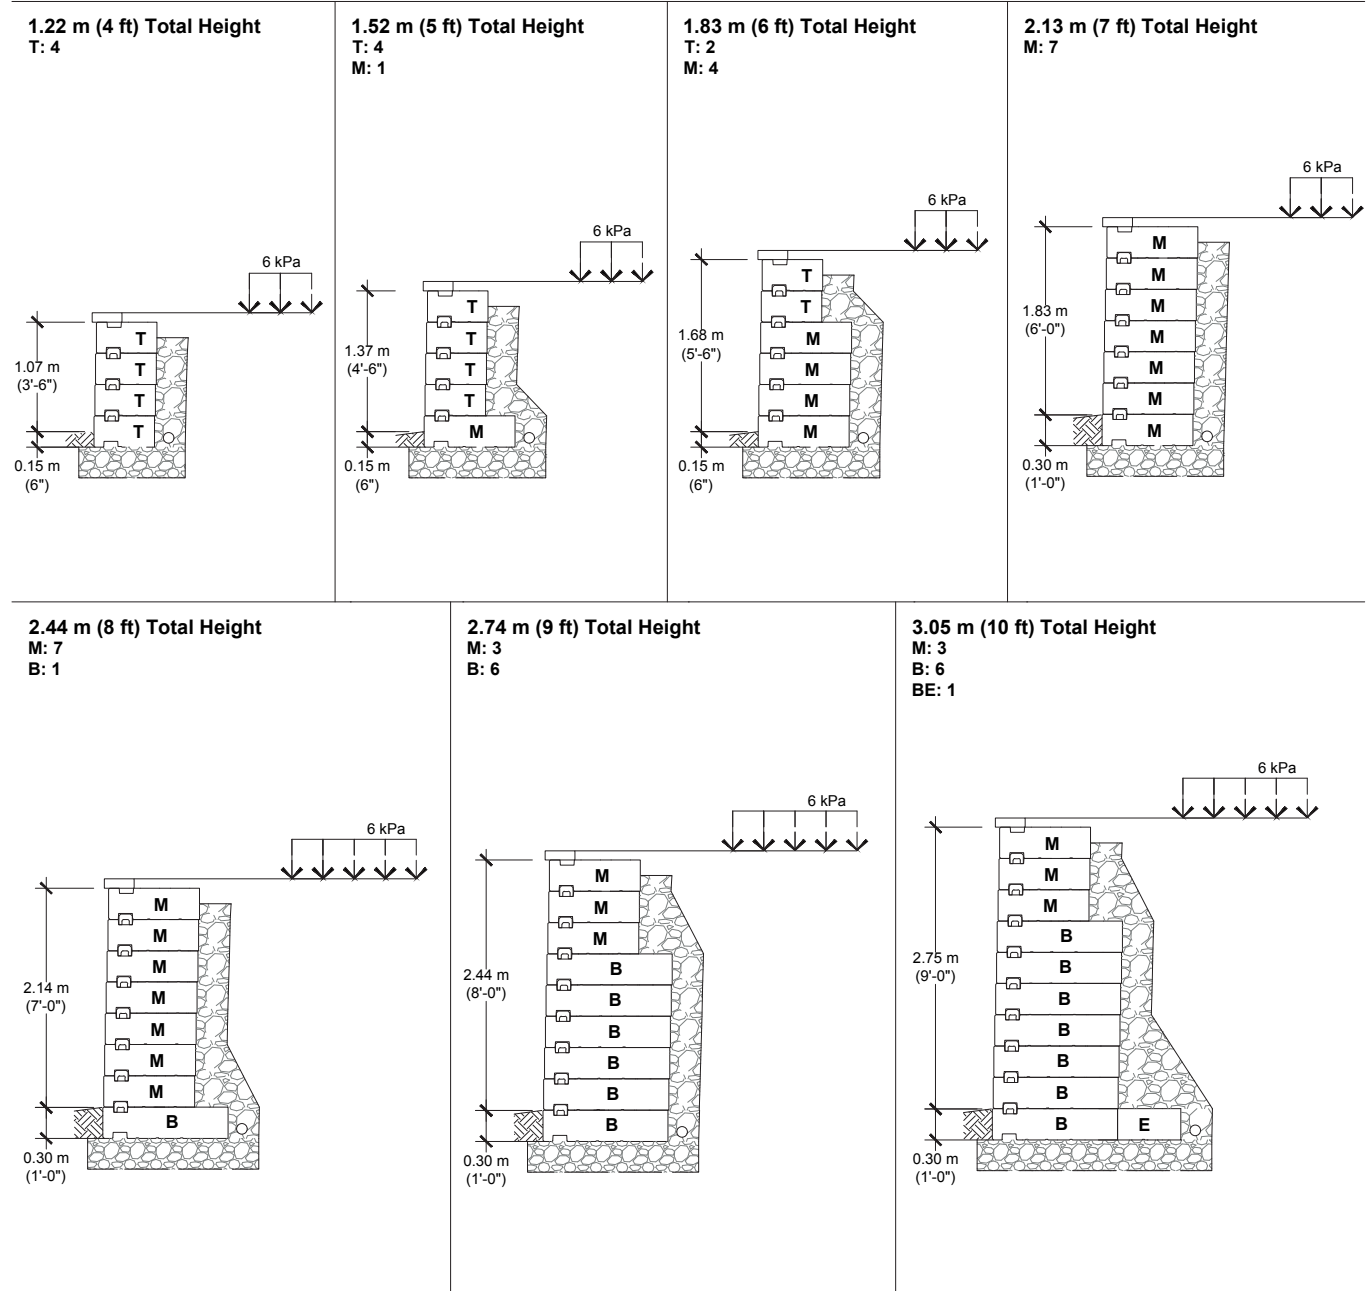

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :

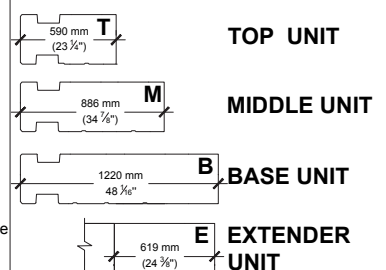

ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 3 :
12 kPa Surcharge
No Backslope
No Toe Slope

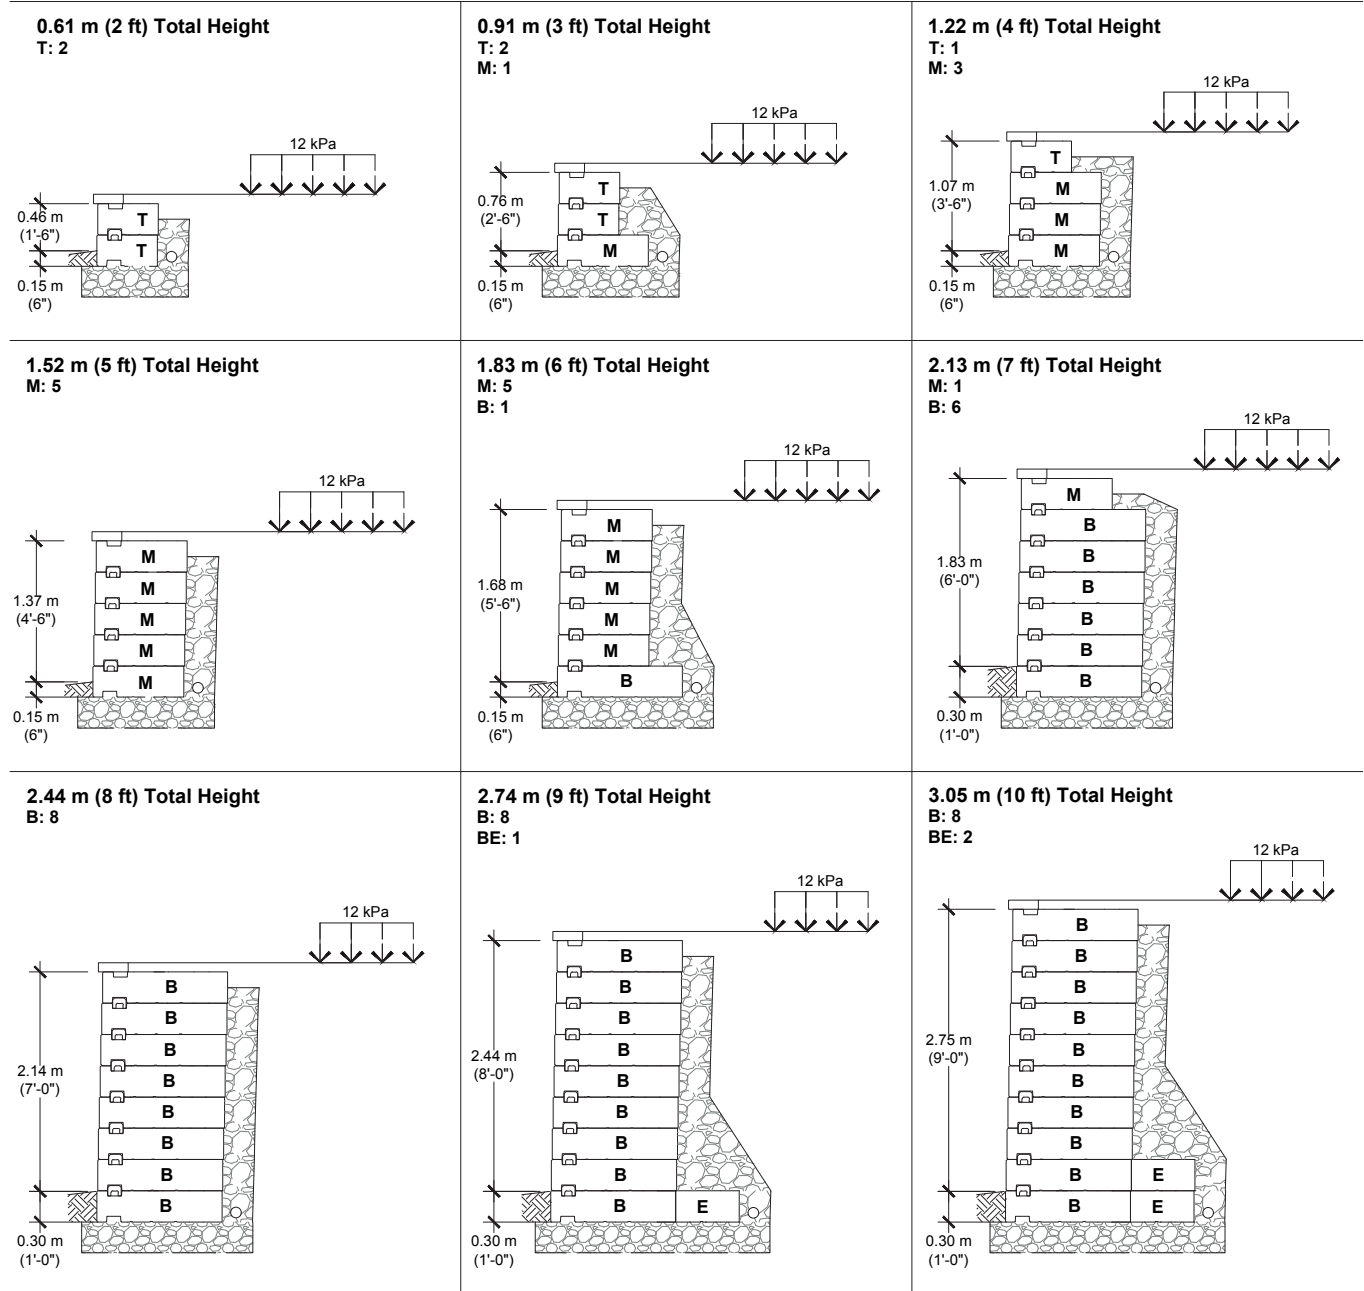

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

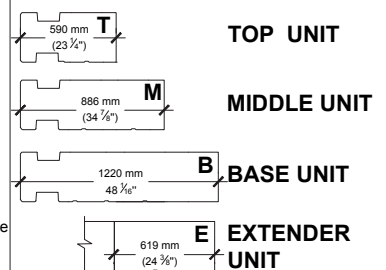


ALLOWABLE STRESS DESIGN


SAND AND GRAVEL MIXES ($\phi=35^\circ$, $\gamma = 22 \text{ kN/m}^3$)

CASE N° 4 :
No Surcharge
Backslope 1V : 3H
No Toe Slope


1.52 m (5 ft) Total Height
T: 5




1.83 m (6 ft) Total Height
T: 4
M: 2




2.13 m (7 ft) Total Height
M: 7

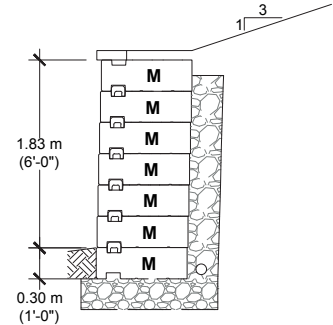


2.44 m (8 ft) Total Height
M: 7
B: 1

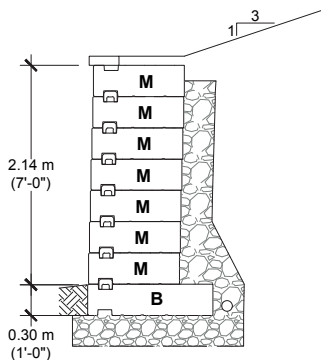

2.74 m (9 ft) Total Height
B: 8

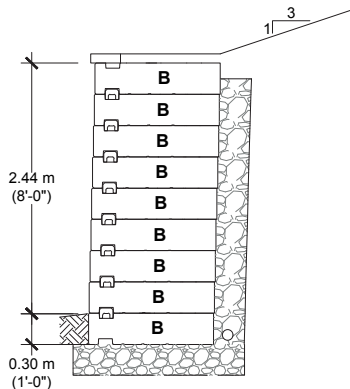


3.05 m (10 ft) Total Height
B: 9
BE: 1

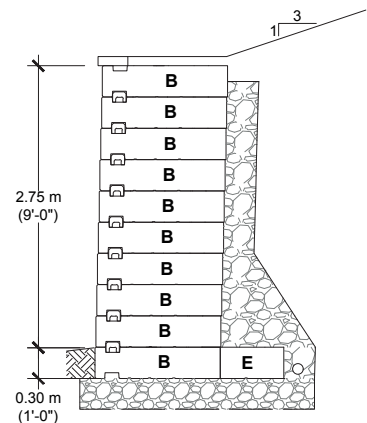


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 35^\circ$, $\gamma = 22 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 5 :
No Surcharge
No Backslope
No Toe Slope


1.22 m (4 ft) Total Height
T: 4




1.52 m (5 ft) Total Height
T: 4
M: 1




1.83 m (6 ft) Total Height
T: 4
M: 2




2.13 m (7 ft) Total Height
T: 2
M: 5




2.44 m (8 ft) Total Height
T: 1
M: 6
B: 1

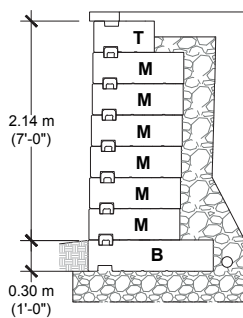

2.74 m (9 ft) Total Height
M: 8
B: 1

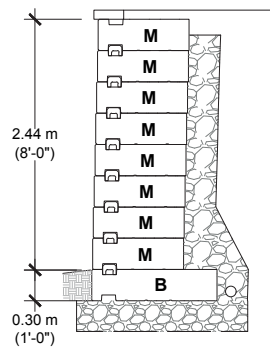


3.05 m (10 ft) Total Height
M: 1
B: 9

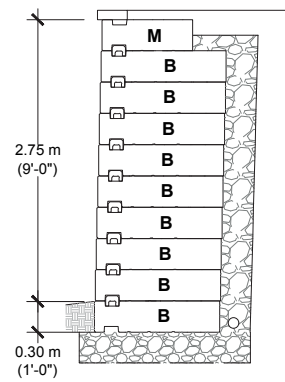


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 6 :
6 kPa Surcharge
No Backslope
No Toe Slope

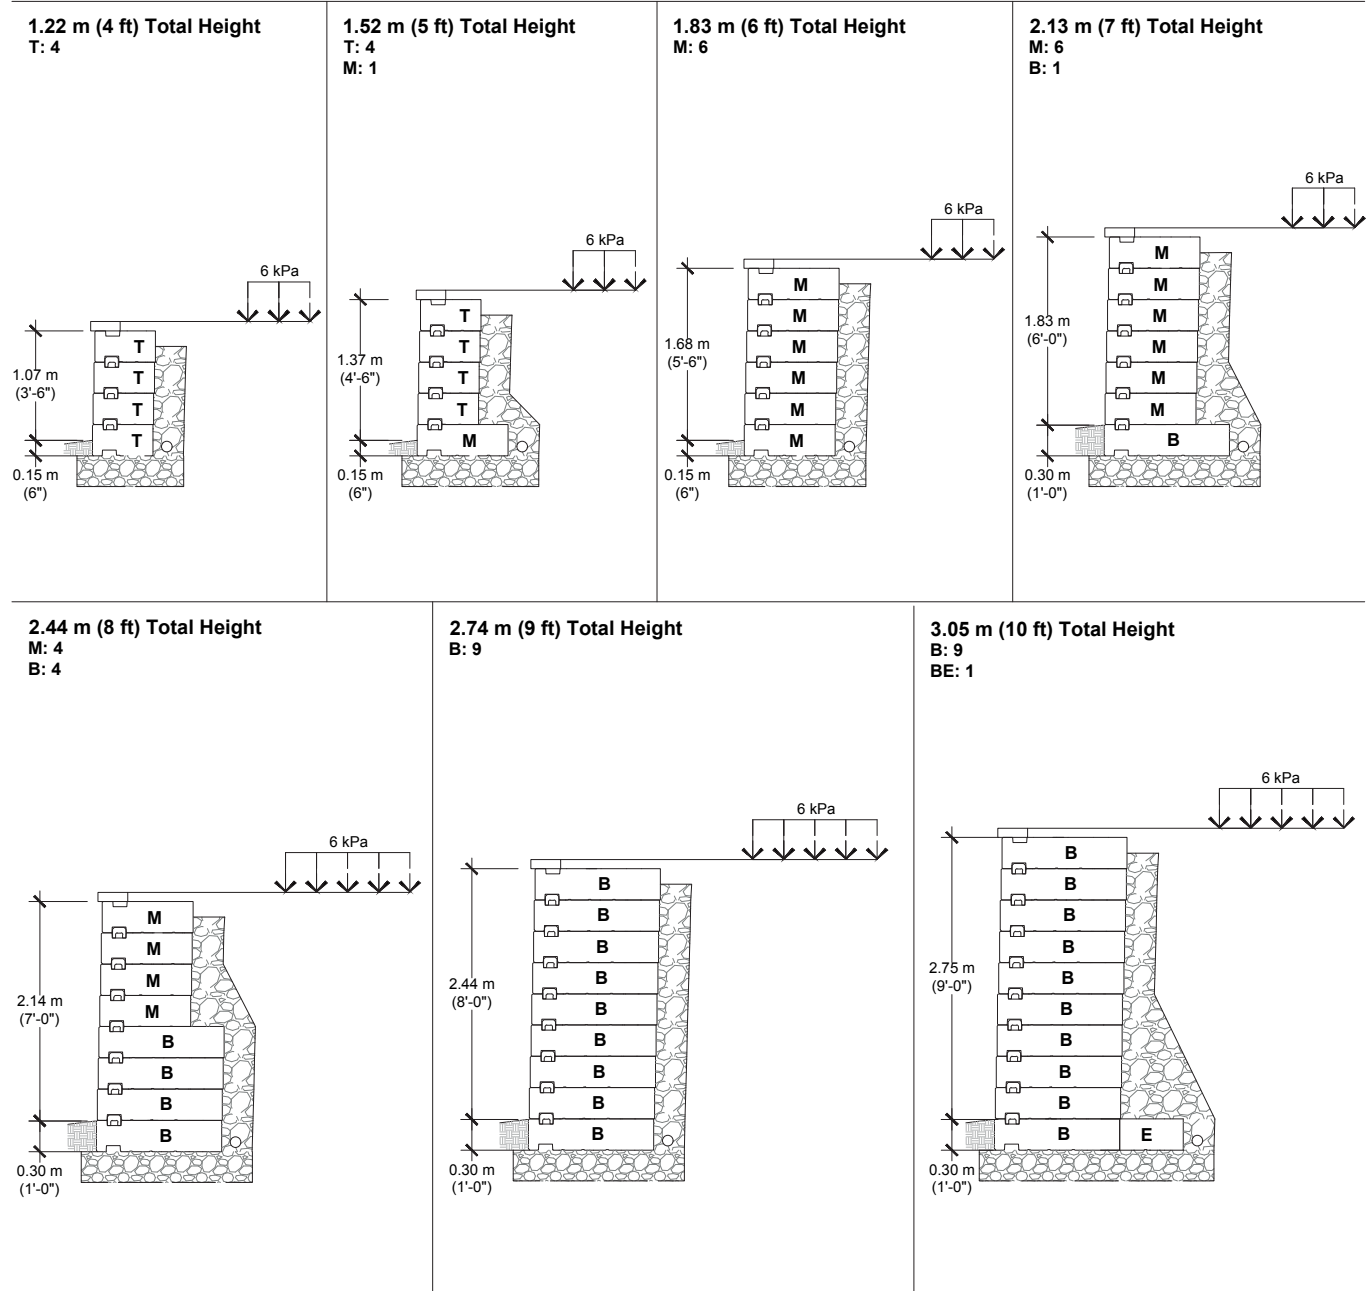

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :

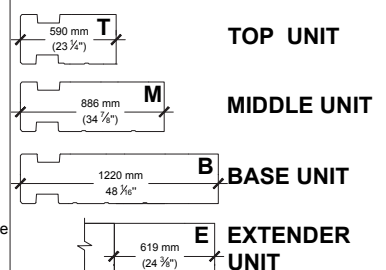

ALLOWABLE STRESS DESIGN


CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 7 :
12 kPa Surcharge
No Backslope
No Toe Slope

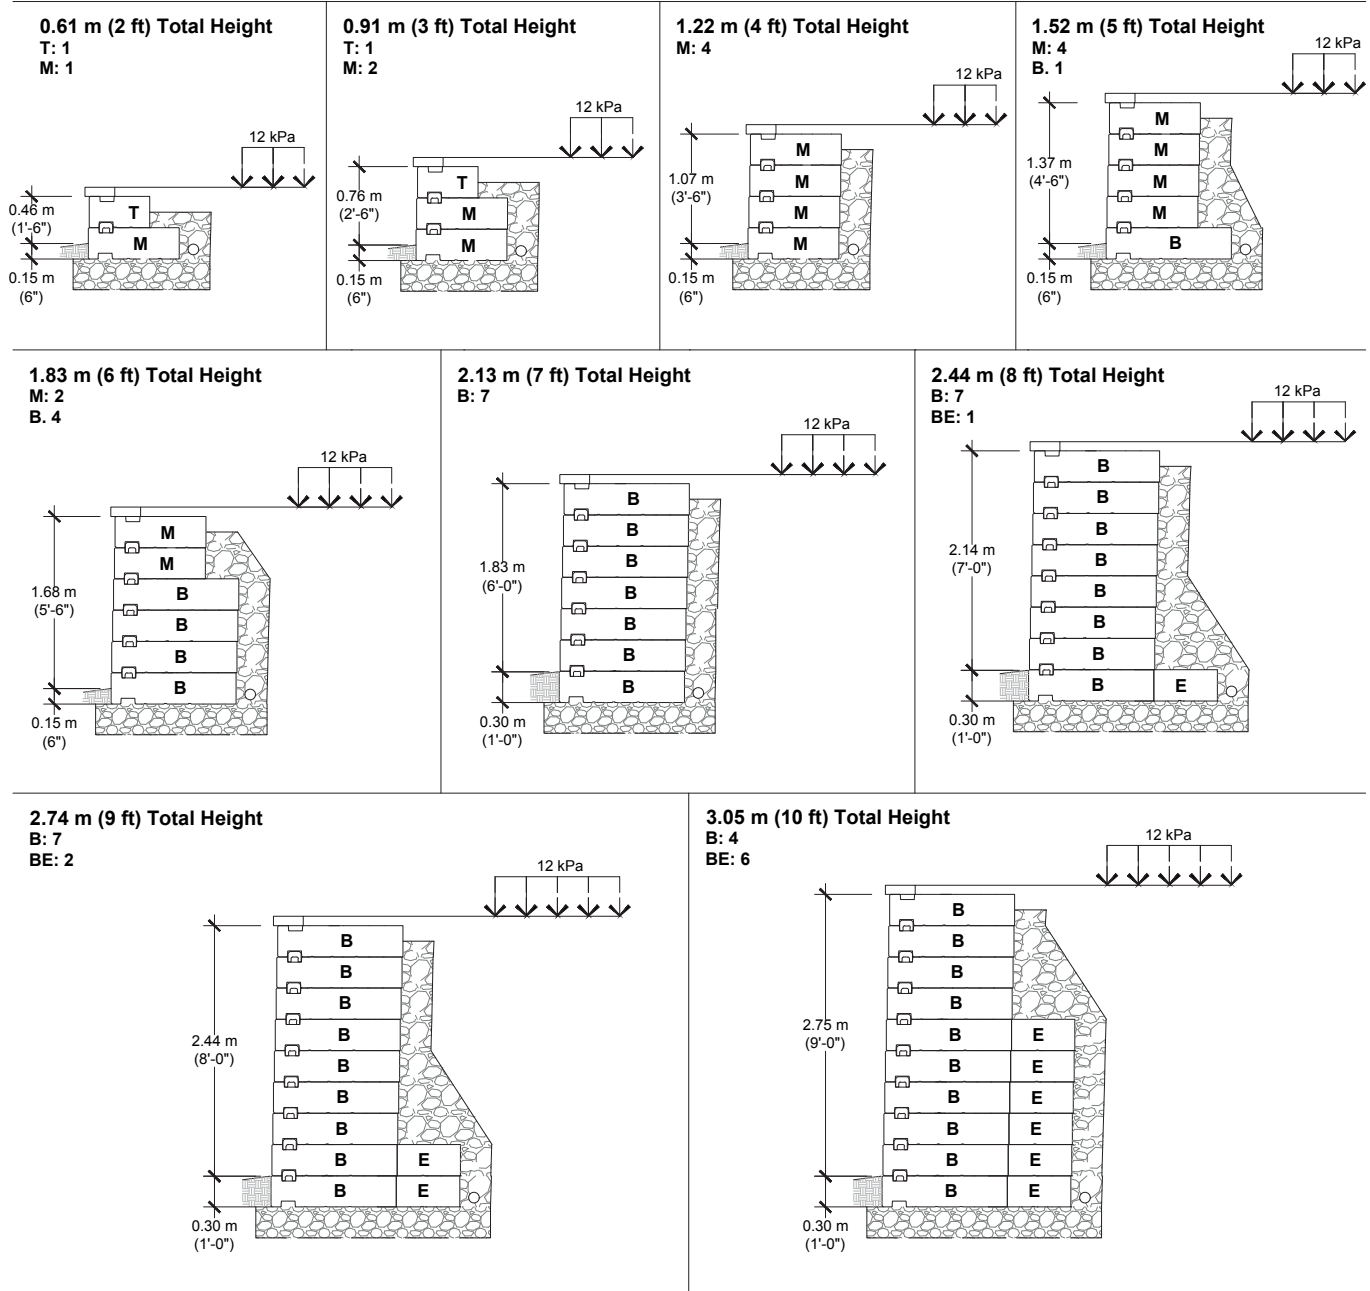

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

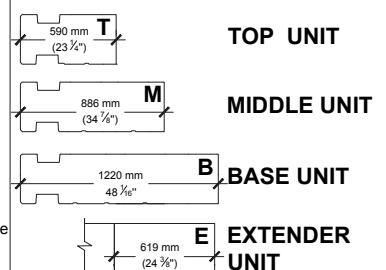


ALLOWABLE STRESS DESIGN

CLEAN SAND ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 8 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


1.22 m (4 ft) Total Height
T: 4




1.52 m (5 ft) Total Height
T: 4
M: 1




1.83 m (6 ft) Total Height
T: 1
M: 5




2.13 m (7 ft) Total Height
M: 6
B: 1

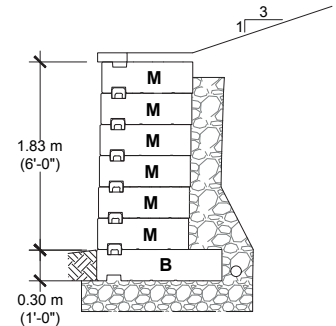


2.44 m (8 ft) Total Height
M: 2
B: 6

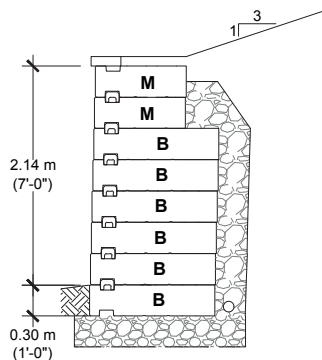

2.74 m (9 ft) Total Height
M: 2
B: 6
BE: 1

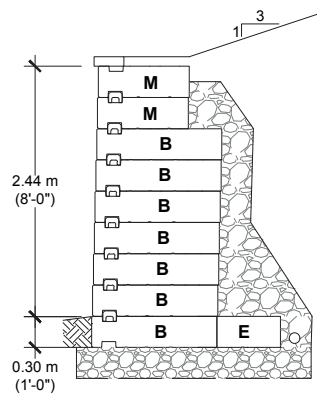


3.05 m (10 ft) Total Height
B: 9
BE: 1

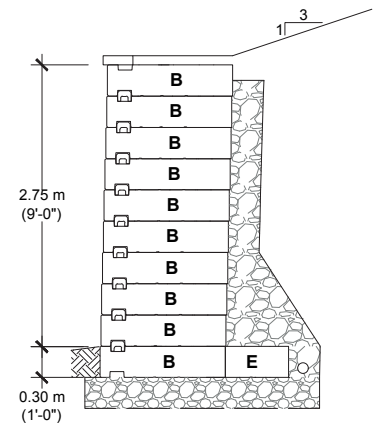


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=32^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT

ALLOWABLE STRESS DESIGN


LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 9 :

No Surcharge
No Backslope
No Toe Slope

0.91 m (3 ft) Total Height


T: 3



1.22 m (4 ft) Total Height

T: 3


M: 1



1.52 m (5 ft) Total Height

T: 2

M: 3




1.83 m (6 ft) Total Height

T: 2

M: 3


B: 1



2.13 m (7 ft) Total Height

M: 4

B: 3




2.44 m (8 ft) Total Height

M: 4

B: 3

BE: 1

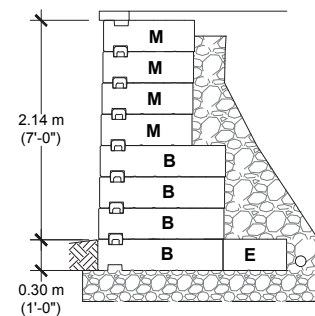


2.74 m (9 ft) Total Height

M: 1

B: 7


BE: 1

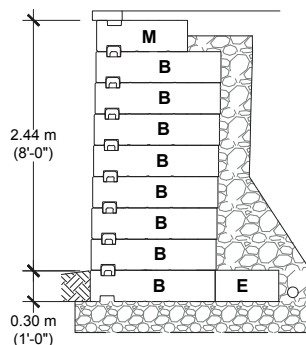

3.05 m (10 ft) Total Height


B: 6

BE: 4

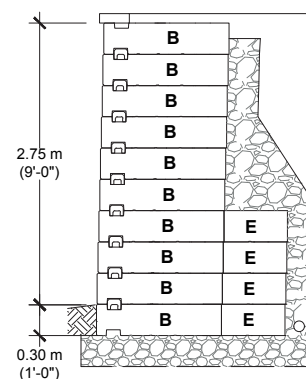


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$).
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 10 :
6 kPa Surcharge
No Backslope
No Toe Slope

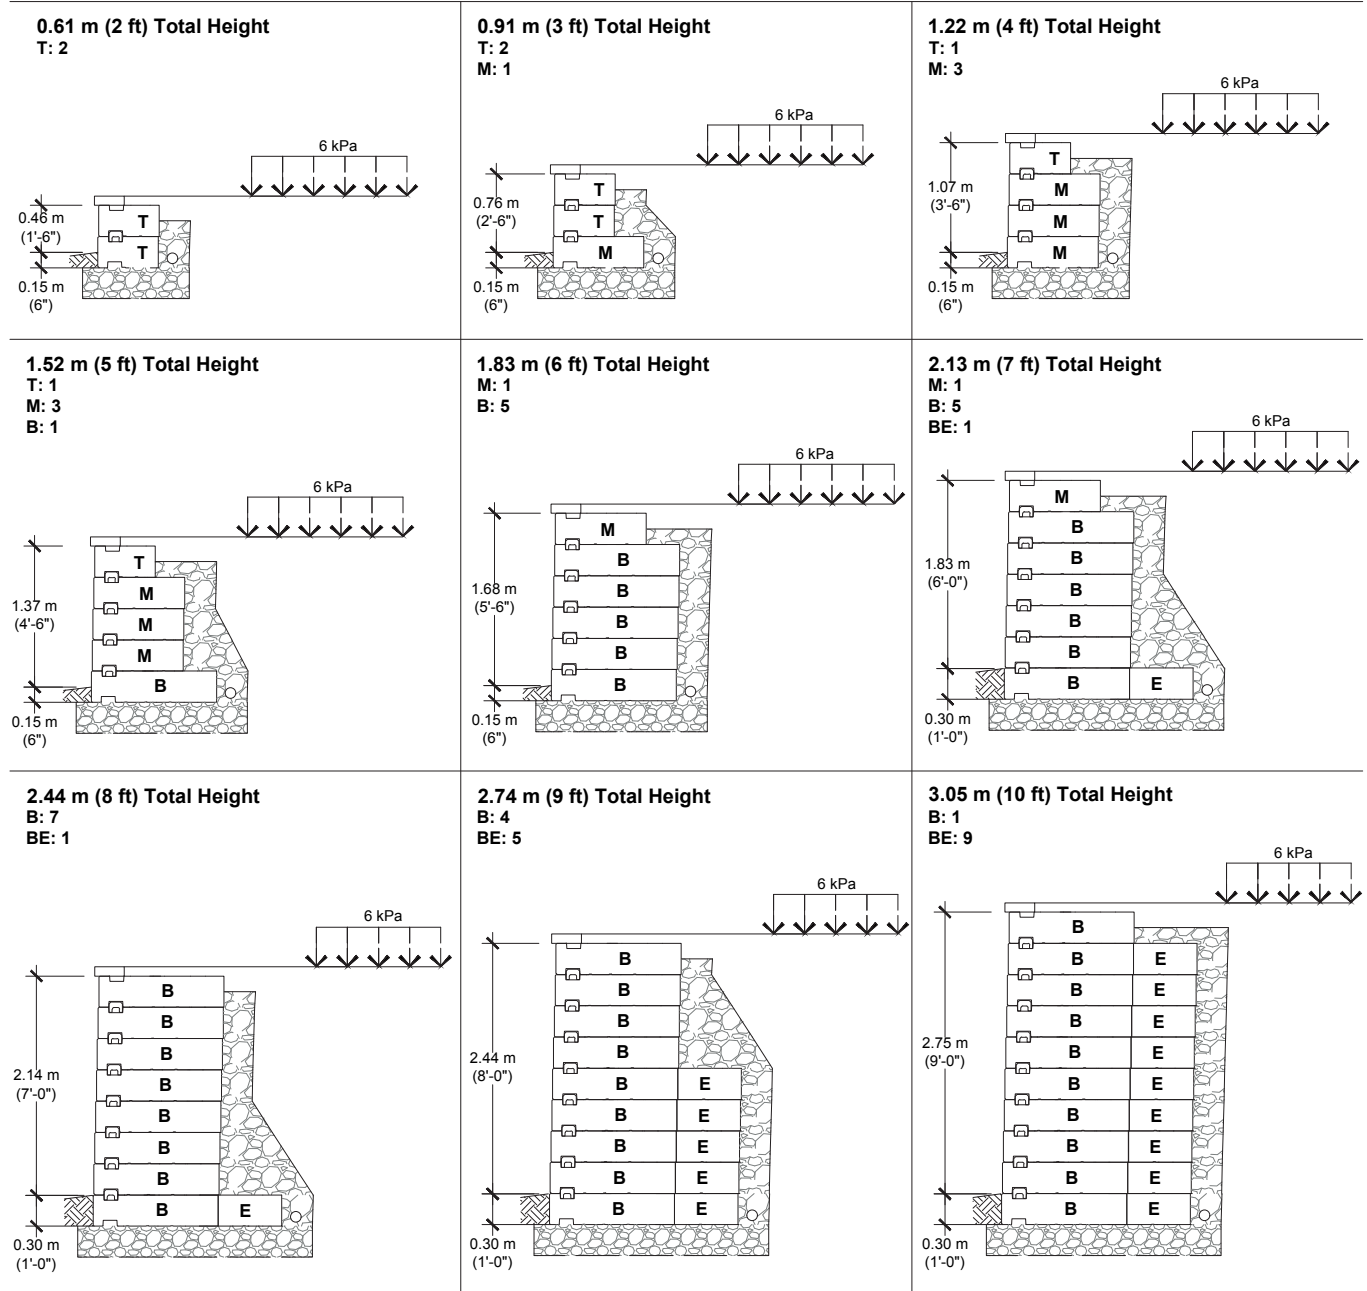

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :

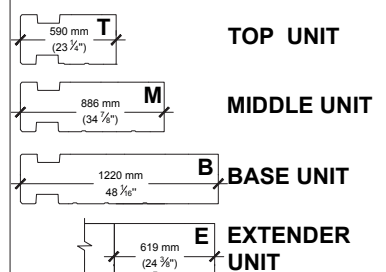

ALLOWABLE STRESS DESIGN


LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 11 :
12 kPa Surcharge
No Backslope
No Toe Slope

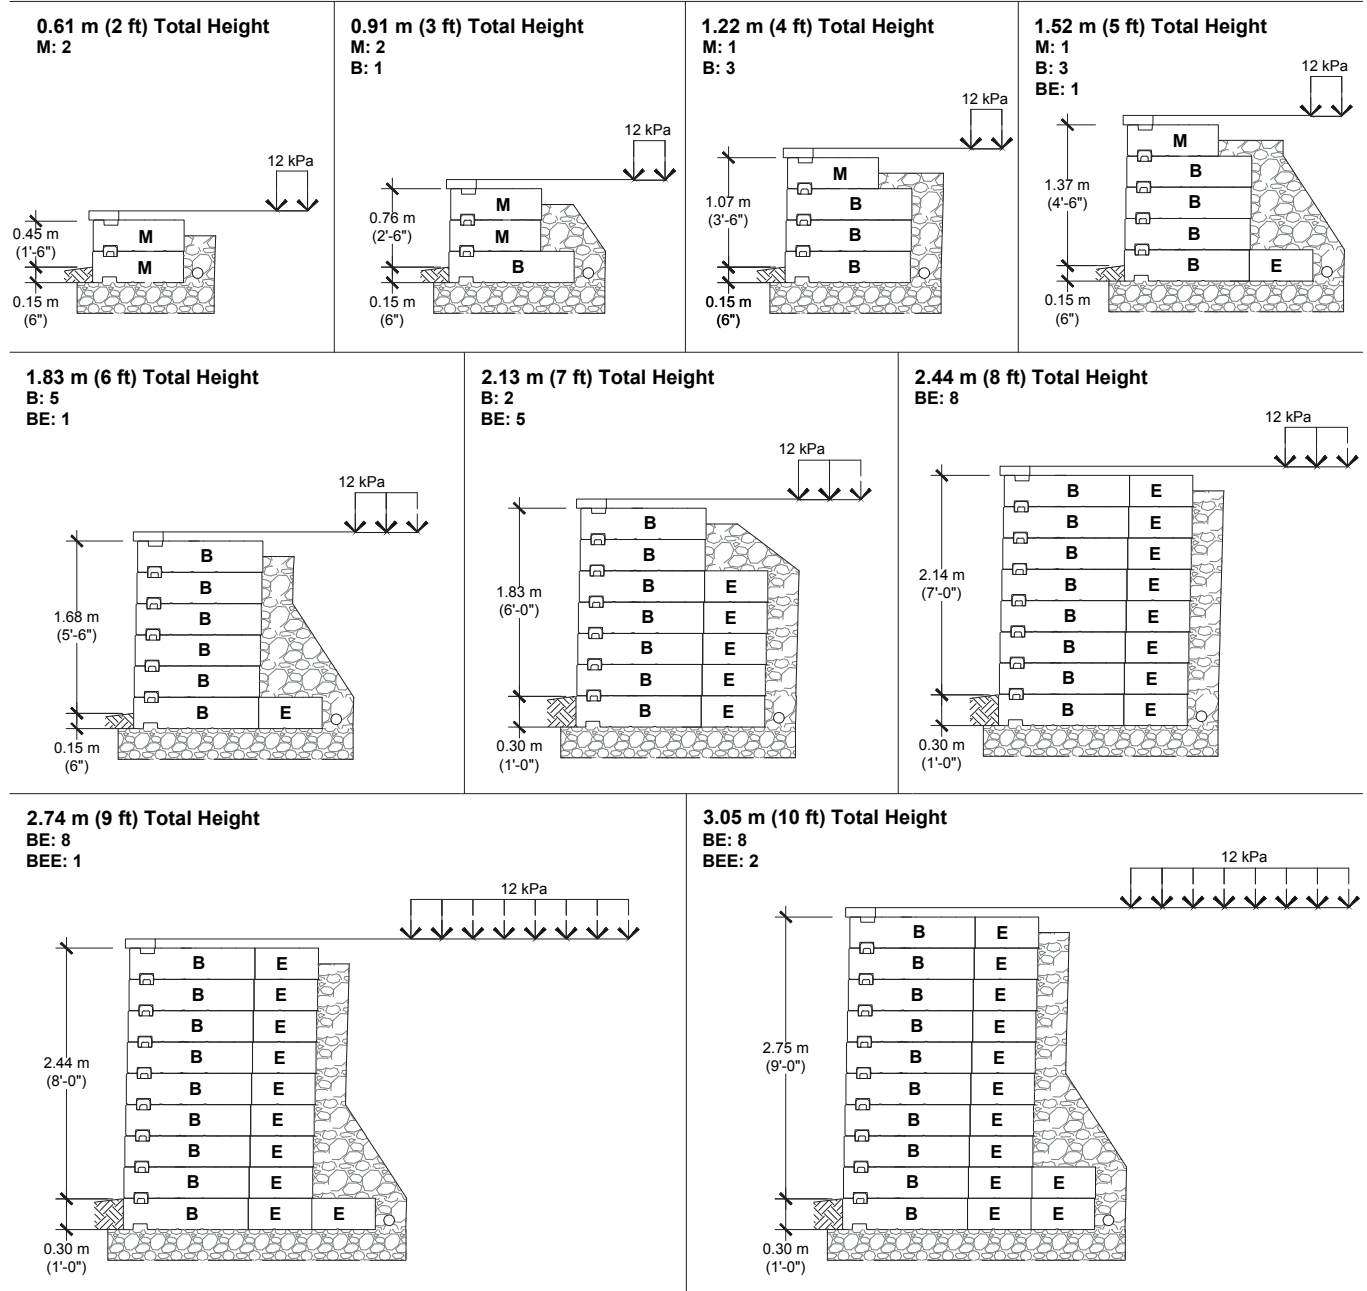

- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.

LEGEND :

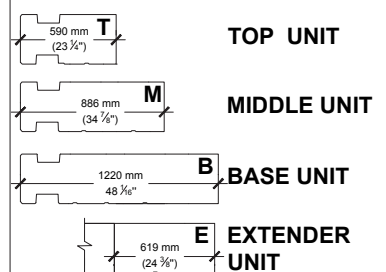


ALLOWABLE STRESS DESIGN

LOW PLASTICITY SILTS AND CLAYS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)


CASE N° 12 :

No Surcharge
Backslope 1V : 3H
No Toe Slope


0.91 m (3 ft) Total Height
T: 3




1.22 m (4 ft) Total Height
T: 3
M: 1




1.52 m (5 ft) Total Height
T: 1
M: 3
B: 1




1.83 m (6 ft) Total Height
B: 5
BE: 1

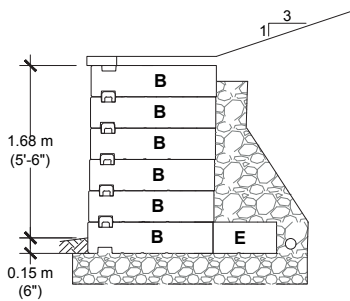


2.13 m (7 ft) Total Height
B: 5
BE: 2

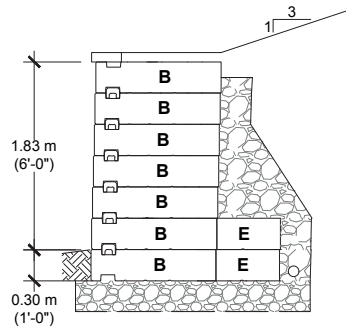


2.44 m (8 ft) Total Height
B: 3
BE: 5

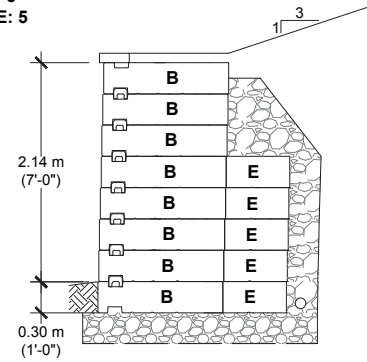

2.74 m (9 ft) Total Height
BE: 8

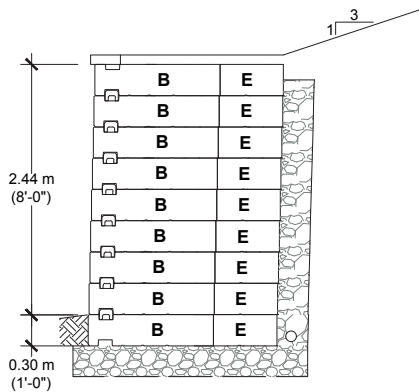


3.05 m (10 ft) Total Height
BE: 9
BEE: 1

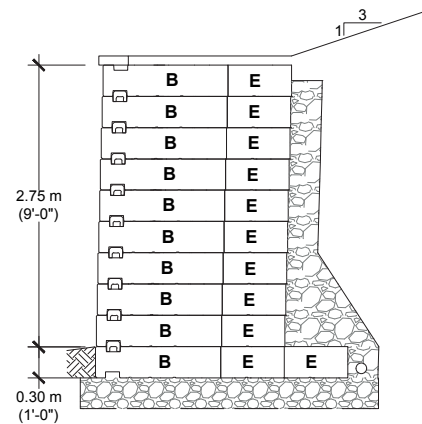


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 13 :
No Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

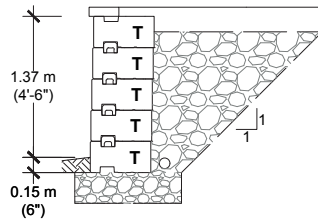


1.83 m (6 ft) Total Height
T: 6

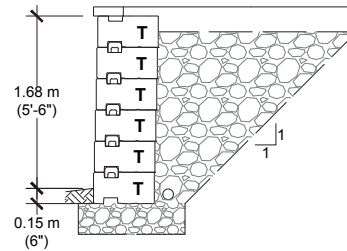


2.13 m (7 ft) Total Height
T: 6
M: 1

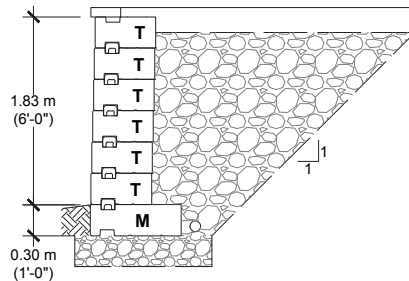


2.44 m (8 ft) Total Height
T: 6
M: 2

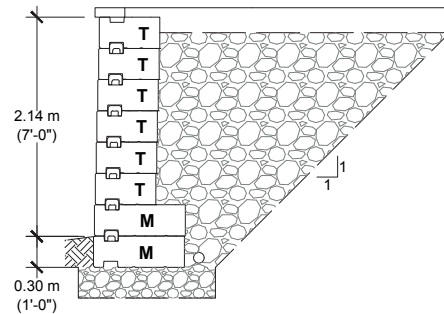

2.74 m (9 ft) Total Height
T: 2
M: 7

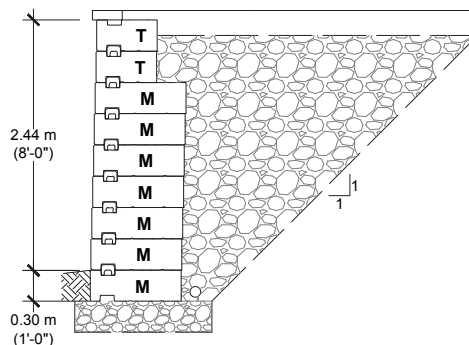


3.05 m (10 ft) Total Height
T: 2
M: 7
B: 1

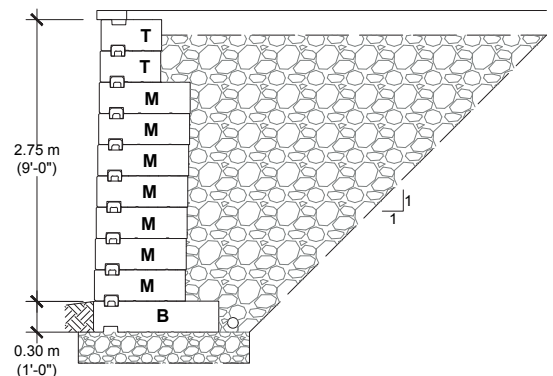


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 14 :
6 kPa Surcharge
No Backslope
No Toe Slope


1.52 m (5 ft) Total Height
T: 5

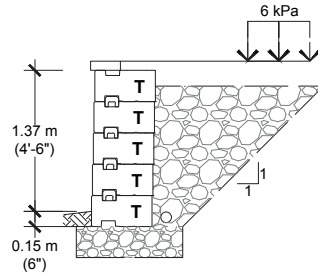


1.83 m (6 ft) Total Height
T: 5
M: 1

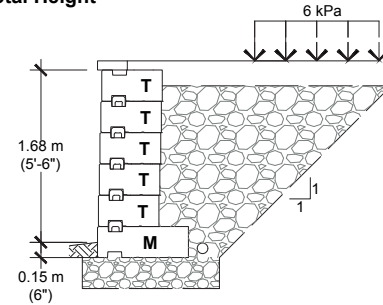


2.13 m (7 ft) Total Height
T: 5
M: 2

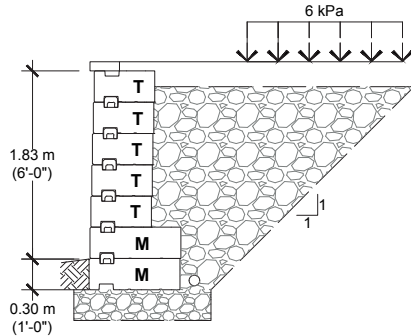


2.44 m (8 ft) Total Height
T: 1
M: 7

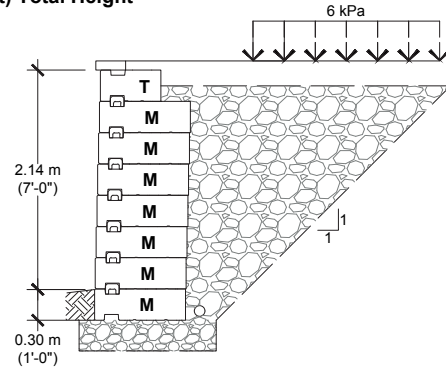

2.74 m (9 ft) Total Height
T: 1
M: 7
B: 1

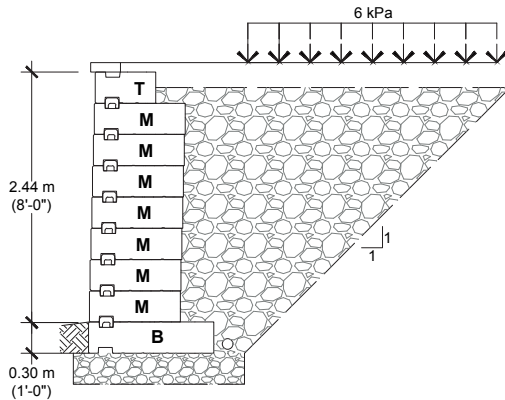


3.05 m (10 ft) Total Height
M: 6
B: 4

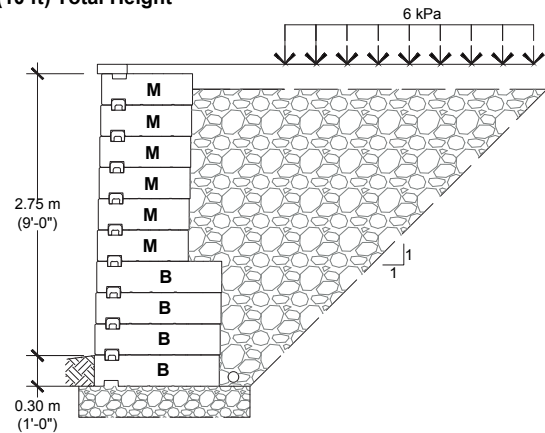


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accepts no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 15 :
12 kPa Surcharge
No Backslope
No Toe Slope


0.91 m (3 ft) Total Height
T: 3

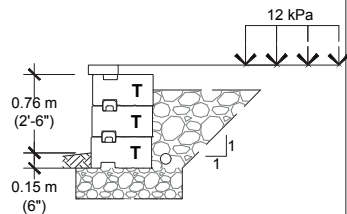


1.22 m (4 ft) Total Height
T: 3
M: 1

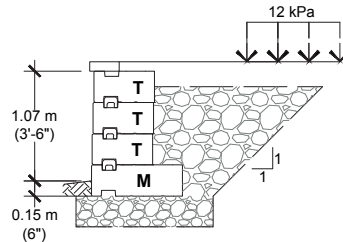


1.52 m (5 ft) Total Height
T: 3
M: 2

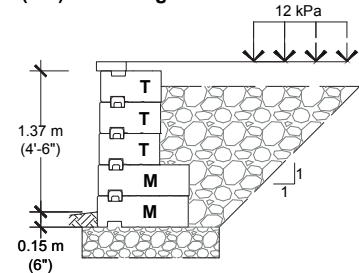


1.83 m (6 ft) Total Height
T: 2
M: 4

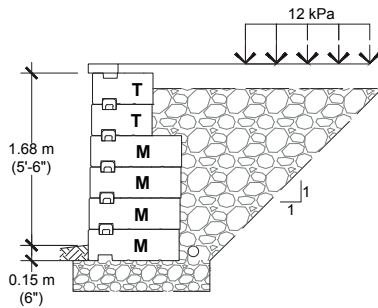


2.13 m (7 ft) Total Height
M: 7

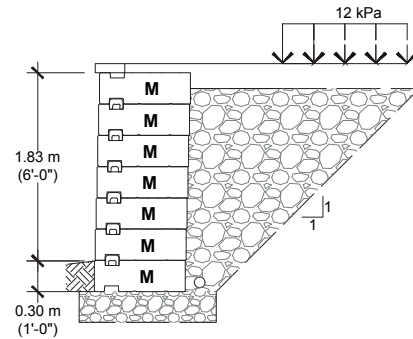


2.44 m (8 ft) Total Height
M: 7
B: 1

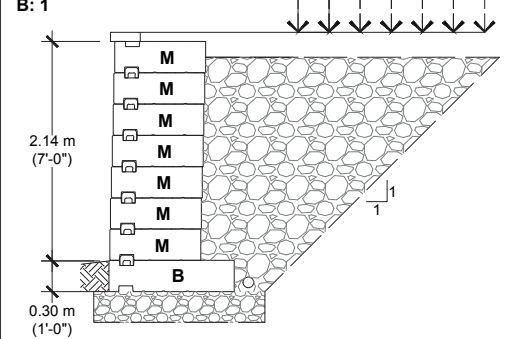

2.74 m (9 ft) Total Height
M: 7
B: 2

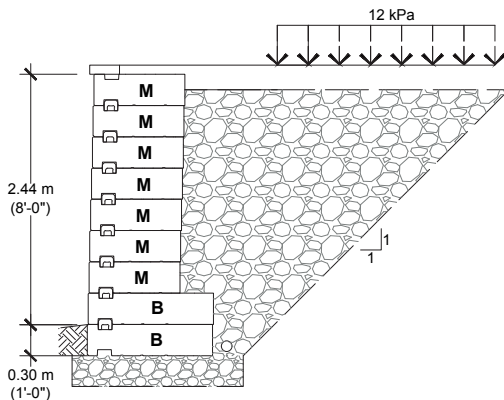


3.05 m (10 ft) Total Height
M: 2
B: 8

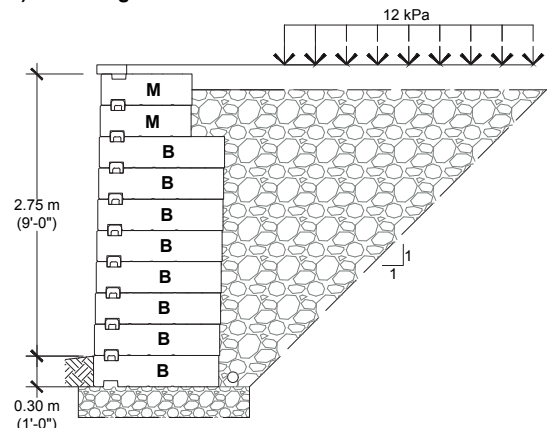


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT




EXTENDER UNIT

ALLOWABLE STRESS DESIGN


CLEAR CRUSHED STONE BACKFILL ($\phi=38^\circ$, $\gamma = 19 \text{ kN/m}^3$)
OVER POOR SOIL CONDITIONS ($\phi=26^\circ$, $\gamma = 20 \text{ kN/m}^3$)

CASE N° 16 :
No Surcharge
Backslope 1V : 3H
No Toe Slope


1.83 m (6 ft) Total Height
T: 6

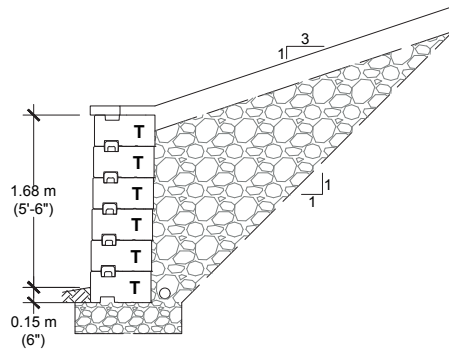


2.13 m (7 ft) Total Height
T: 6
M: 1

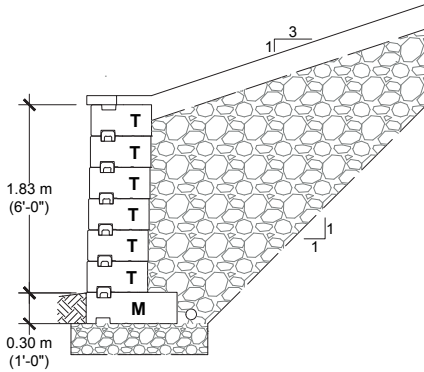


2.44 m (8 ft) Total Height
T: 6
M: 2

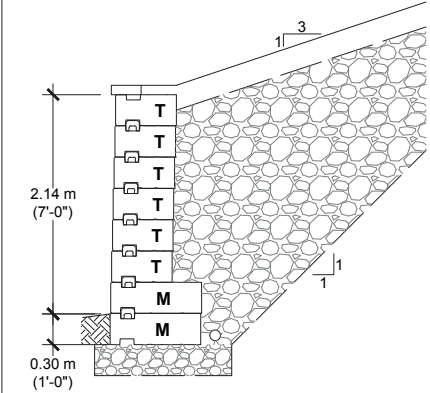

2.74 m (9 ft) Total Height
M: 9

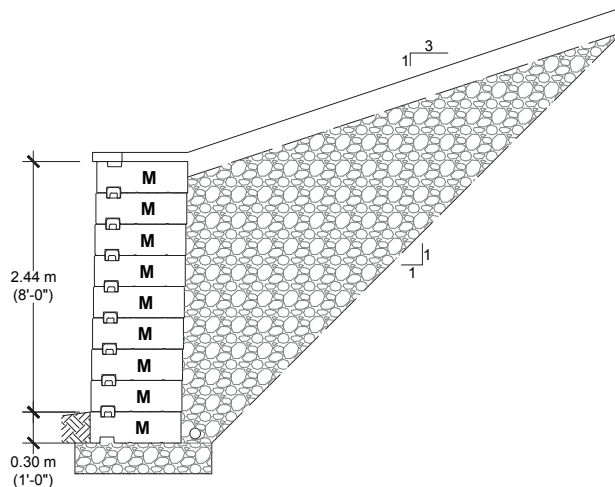


3.05 m (10 ft) Total Height
M: 9
B: 1

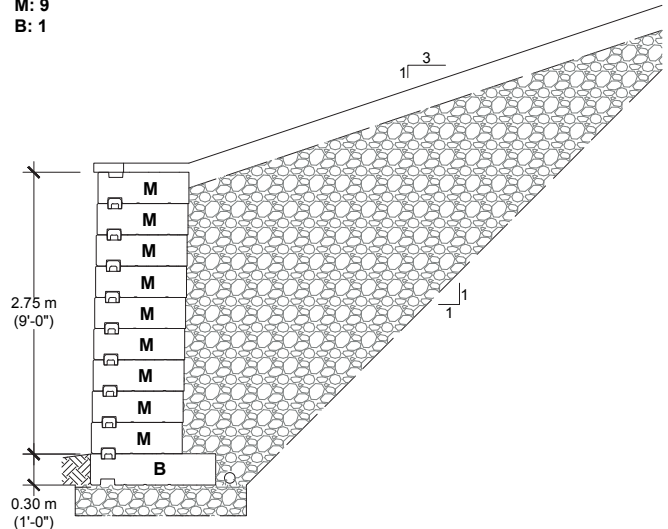


- The information contained in the design charts is supplied for information purposes only and as such should only be used for preliminary designs.
- The height (H) of the wall does not include the thickness of the cap.
- Soil parameters: retained soil ($\phi = 38^\circ$, $\gamma = 19 \text{ kN/m}^3$); foundation soil ($\phi = 26^\circ$, $\gamma = 20 \text{ kN/m}^3$)
- A qualified engineer should be consulted for the final design to be used for construction.
- The foundation soil must be able to support the wall system. The bearing capacity of the foundation soil, settlement, and global stability must be verified and validated by a qualified geotechnical engineer.
- The seismic analysis is not included.
- The design charts do not apply to tiered walls.
- The charts assume that the walls are constructed in accordance with Techo-Bloc specifications, good construction practice and an adequate drainage system.
- Engineering judgement should be used when interpolating between heights.
- Techo-Bloc and its predecessors, successors, beneficiaries, employees, associates, administrators and insurers accept no liability for the incorrect use of information contained in the design charts.
- For further information, please contact our technical service department.


LEGEND :




TOP UNIT



MIDDLE UNIT



BASE UNIT



EXTENDER UNIT

CANADA

MONTREAL

5255 Albert-Millichamp Street,
Saint-Hubert, QC J3Y 8Z8

CHAMBLY

7800 Samuel-Hatt Street
Chambly, QC J3L 6W4

OTTAWA

3455 Hawthorne Road,
Ottawa, ON K1G 4G2

TORONTO

10 Freshway Drive,
Vaughan, ON L4K 1S3

TORONTO

1050 Industrial Road,
Ayr, ON N0B 1E0

USA

ILLINOIS

8201, 31st Street West,
Rock Island, IL 61201

ILLINOIS

24312 W. Riverside Dr,
Channahon, IL 60410

INDIANA

2397 County Road 27,
Waterloo, IN 46793

MARYLAND

6710 Binder Lane
Elkridge, MD 21075

MASSACHUSETTS

70 East Brookfield Rd.,
North Brookfield, MA 01535

MINNESOTA

4372 170th Street West
Farmington, MN 55024

NEW YORK

55-65 South 4th Street,
Bay Shore, NY 11706

NORTH CAROLINA

5135 Surrent Drive,
Archdale, NC 27263

OHIO

97 Industrial Street,
Rittman, OH 44270

PENNSYLVANIA

852 W. Pennsylvania Avenue,
Pen Argyl, PA 18072

PENNSYLVANIA

23 Quarry Road,
Douglassville, PA 19518

CONTACT US

TOLL FREE:

1.877.832.4625

WWW.TECHO-BLOC.COM

PROUD MEMBER OF



TECHO—BLOC

INSPIRING ARTSCAPES

